

City of Elkhorn

**Residential Building Permit
Information Packet**

Decks

City of Elkhorn

Decks

The following is required for all decks and must be included in packet returned to the building inspector:

1. Building/Zoning application
 - ✓ Application **must** be filled out completely to insure prompt service
 - ✓ Application **must** include the name, address and license number of **all** contractors
2. Site plan showing:
 - ✓ Dimensions of the lot
 - ✓ Location and dimensions of all existing structures and the proposed deck
 - ✓ Distances between the principal structure and the proposed deck
 - ✓ Location of any wells, septic systems, leech beds or electric service pedestals
 - ✓ Distances from proposed deck to side, rear and street lot lines
 - ✓ Side section showing the proposed type of materials to be used
 - ✓ Height of deck from grade to floor of deck
 - ✓ All plans shall be prepared with a recognized engineering or architectural scale, include north arrow and abutting street right-of-ways

** It is your responsibility as the applicant to place the permit card on the premises, visible from the street and protected from the weather. Construction Drive and silt fence shall be installed prior to construction.

**Inspection requests need to be called in with 48 hrs notice preferred, although same day inspections may be handled. Please see attached sheets for a list of the required inspections and the information needed when requesting an inspection.

City of Elkhorn
Building Inspection & Zoning Departments

Building Inspector

(262) 741-5115

Zoning Administrator

(262) 741-5124

Inspections Needed Checklist

1. **Sanitary sewer, storm sewer and water lateral:** **BEFORE** backfilling of trench. System should be on test at time of inspection.
2. **Footing forms:** **BEFORE** any concrete is poured, bleeders must be installed eight feet on center.
3. **Foundation wall drain tiles:** **AFTER** 12" of stone is in place on top of tiles and 12" beyond edge of footing.
4. **Building sanitary drain:** **BEFORE** basement floor is poured.
5. **Basement floor:** **BEFORE** basement is poured and **AFTER** vapor barrier is in place. Clean out bleeder ends!!!
6. **Electrical Service:** **BEFORE** electric utility connection, underground pedestal or overhead service. Mark service location on survey.
7. **All roughs (carpentry, electrical, plumbing, HVAC):** **BEFORE** insulating.
 - ✓ These should be called in together whenever possible
 - ✓ At this time, all penetrations should be sealed for inspection
 - ✓ Copy of Truss specs shall be supplied for the inspector at Rough Inspection
8. **Insulation:** **BEFORE** applying any finished materials.
9. **Final Inspection:** **ALL** carpentry, electrical, plumbing HVAC and other mechanical installations **BEFORE** any occupancy will be issued. (Working kitchen, one complete full bathroom, final grade, address sidewalk and driveway if applicable).
10. **Water Meter:** **MUST** be installed prior to occupancy.

Failure to request an inspection is in violation of Local and State Building Code and will be subject to a fine, which will be levied against the property owner.

Certificate of Occupancy: will be issued after a final inspection has been done and the building inspector deems the property suitable for occupancy. The building may not be occupied until a certificate has been issued.

Inspection Requests Information

To schedule an inspection

Call:

(262) 741-5115

Please be ready to provide the following information. Your inspection **CANNOT** be scheduled without this information

- Municipality
- Inspection Address
- Permit Number
- Owner's Name
- Contractor
- Contact Phone Number
- Inspection Type
- Date & Time Ready for Inspection

Access for the inspector is required (ex: ladder, lock box, key location, etc.)

Inspection requests need to be called in with **48 hours notice preferred**, although same day inspections may be handled. Please see attached sheets for a list of required inspections and the information needed when requesting an inspection.

Thank You for your Cooperation!

Sample of Scale Plot Plan – Directions

1. List the direction of north on the plot
2. List what the scale is (e.g. 1'=30')
3. Draw all structures existing and proposed on the plan to scale
4. Show location of well and septic
5. Be sure that the setbacks listed on the application are the same as on the plot plan
6. Label all structures
7. Setbacks are the distances from the closest point of a structure to a lot line
8. Show all streets that border the property
9. Setback requirements with a scaled plot plan are one and one half times the normal requirement that would be accepted with a plat of survey. EX: If the zoning requirement setback from the rear yard to the structure is 50 feet, it would be 75 feet if you are using a scaled plot plan. (A plat of survey is a survey done by a Wisconsin licensed surveyor).
10. Show the location of the driveway. This locates the front of the structure for zoning purposes

This is the minimum of information that is required

**WITHOUT THIS INFORMATION YOUR APPLICATION WILL BE DENIED AND
LENGTHEN THE TIME IT TAKES TO ISSUE YOUR PERMIT**


Building Permit – Plot Plan

EXAMPLE:

Date: ____ / ____ / ____
 Name of Applicant: _____
 Address: _____
 Phone Number: _____
 Project Description: _____
 Present Zoning: _____

Important Required Data:

- A – Lot Stakes Must Be Accessible**
- B – Show All Present Existing Buildings or Structures on your Lot**
- C – Lot Size and Building Location**
- D – Indicate North Direction**
- * Dimensions as Per Zoning Ordinance**

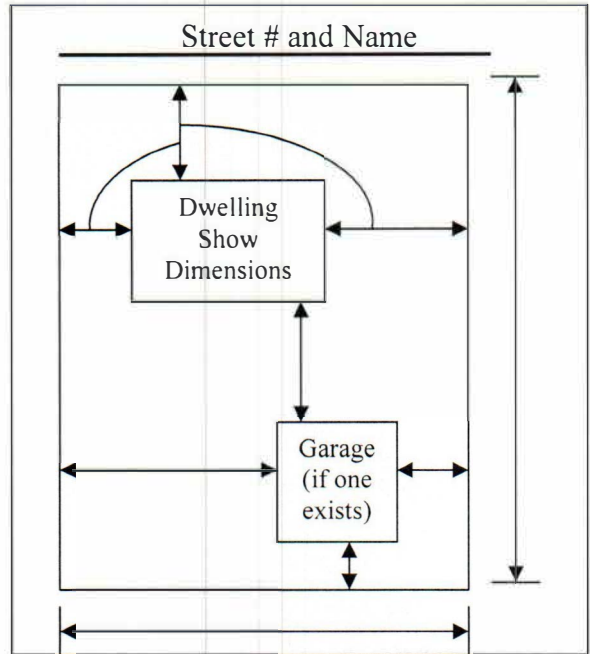

.....

Sketch Your Plot Plan Below – Supply Complete Information – Locate Buildings On Lot & Show All Dimensions To Lot Lines – See Sketch Above For Example

Date: ____ / ____ / ____ Signature: _____

Deck Standards

All work shall not commence until a permit is approved and issued. All work shall be performed in accordance with these standards:

Definitions

1. Deck: any structure which serves as a raised horizontal platform on a floor constructed of wood or other materials without enclosing a wall or roof
2. Attached Deck: any deck that is physically connected to the principal building or accessory building or any deck used for exiting purposes, whether or not physically attached
3. Detached Deck: any deck, which is not physically attached to the principal building or accessory structure and located in the accessory yard

Soil & Excavation Requirements for Deck Piers or Foundation

1. No pier shall be placed on soil with a bearing capacity of less than 2,000 pounds per square foot unless the pad support is designed through structural analysis
2. All organic material (roots, etc.) shall be cut off at the sidewalls of the borings or trench. All organic and loose material must be removed from the cavity area prior to pouring concrete

Deck Piers, Pads and Foundations

1. General footings, pads, or piers shall be adequate bearing area to safely distribute all live loads to the supporting soil without exceeding the bearing capacity of the soil
2. Type and size of concrete pads, piers or foundations
 - a. Decks attached to principal buildings and detached decks used as an exit from the principal building:
 - ✓ Concrete pads: the footing shall be 48" below grade. The minimum dimensions of this pad shall be 8" in diameter
 - ✓ Piers: the minimum depth of concrete piers shall be 48" below grade. The minimum dimensions of this pier shall be 8" in diameter. The concrete pier(s) shall extend a minimum of 6" above grade unless and approved mounting bracket is secured at the top surface of the pier(s).

Framing

1. General Requirements
 - a. Materials: All wood framing used in deck construction shall be pressure-treated against decay or shall be a species of wood that is natural decay resistant
 - b. Design Location: Decks shall be designed for a minimum of 40 pound per square foot loading
2. Column Posts
 - a. Column Spacing: Column posts shall be spaced per Comm.20.25 Standards
 - b. Column Size (measured from grade to deck joists):
 - ✓ All column posts not exceeding six feet (6') in height shall be a minimum of four inches by four inches (4"x4") nominal thickness
 - ✓ All column posts exceeding six feet (6') in height shall be a minimum of four inches by six inches (4"x6") nominal thickness

- c. Lateral Support: Decks over four feet (4') in height above grade shall be constructed in such a manner of mechanically attached to the deck foundation to resist lateral movement
3. Beams
 - a. Beam Size: All beams shall be sized per Comm.20.25 Standards
 - ✓ Beams shall be a minimum of two (2), two inch (2") member (2-2x8) or one (1), four inch (4") thick member (1-4x8)
 - ✓ Beams maybe spaced on each side of the post provided that blocking is installed minimum of twenty-four inches (24") on center between the beam members

Guardrails and Handrails

1. Guardrails: All decks, which are more than twenty-four inches (24") above grade, shall be protected with guardrails
2. Handrails: Every stairway of more than three (3) risers or twenty-four inches (24") shall be provided with at least one handrail. Handrails or guardrails shall be provided on all open sides of stairways
3. Guardrails and Handrail details:
 - a. Height: Handrails shall be located at least thirty inches (30"), but not more than thirty-eight inches (38"), above the nosing treads. Guardrails shall be located at least thirty-six inches (36") above the surface of the deck
 - b. Open Railings: Open guardrails or handrails shall be provided with intermediate rails or an ornamental pattern to prevent the passage of sphere with a diameter greater than four inches
 - c. Railing Loads: Handrails and guardrails shall be designed and constructed to withstand a 200-Pound load applied in any direction

Stairway-Treads and Risers

1. Risers: shall not exceed eight inches (8") in height measured from tread to tread
2. Treads: shall be at least nine inches (9") wide, measured horizontally from nose to nose
3. Variation: there shall be no variation in uniformity exceeding 3/16 inch in the width of a tread or in the height of risers
4. Stair stringers shall be supported in accordance in the same manor as used for the deck

Alternative Provisions and Methods

Comm.21.225 Decks

Decks attached to dwellings and detached decks which serve an exit shall comply with the applicable provisions of this chapter, including but not limited to:

1. Excavation requirements of s. Comm.21.14
2. Footing requirements of s. Comm.21.15
3. Frost penetration requirements of s. Comm.21.16
4. Load requirements of s. Comm.21.02
5. Stair, handrail and guardrail requirements of s. Comm.21.04
6. Decay protection of requirements of s. Comm.21.10

*** CODES FOR DECKS ***

If the deck is attached to a building, or if detached but serves as an exit, the post holes (footings) must be 48" below finished grade. These holes must be inspected before being filled.

Floor joists within 18" of the earth and girders within 12" of the earth must be pressure treated.

Any stringers or joists of 8' in length shall be supported on joist hangers.

STAIRS: Stair width must be at least 36".

Risers shall not exceed 8" in height, measured vertically from tread to tread.

Treads shall be at least 9" wide, measured horizontally from nosing to nosing.

There shall be no variation in uniformity exceeding 3/16" in the width of the tread or in the height of the riser.

HANDRAILS: Every stairs of more than 3 risers shall be provided with at least one handrail.

Handrails shall be provided on all open sides of stairways.

Handrails shall be located at least 30" but not more than 34" above the nosing.

Width of handrails shall not be more than ~~3~~² and 1/8 inches.

GUARDRAILS: Decks that are more than 24" above grade shall be protected by guardrails.

Guardrails shall be at least 36" above the upper surface of the floor.

Open guardrails or handrails shall be provided with intermediate rails or all ornamental pattern with openings no larger than ~~6"~~^{4"}.

Handrails and guardrails shall be designed and constructed to withstand a 200lb. load applied in any direction.

Handrails and guardrails shall be decay resistant or pressure treated wood.

All other provisions of the appropriate codes shall be adhered to.


Subdivision regulations and deed restrictions, if any, must be adhered to along with the appropriate zoning restrictions for the district.

In some locations, a zoning permit may be required before a building permit can be issued.

A FINAL INSPECTION IS REQUIRED UPON COMPLETION.



21.04(2)(a)5. HANDRAIL SHAPES

ROUND

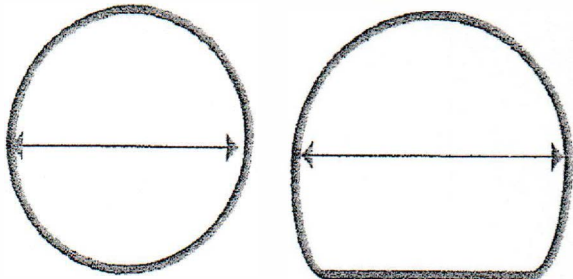


MAXIMUM 2"
DIAMETER

RECTANGULAR

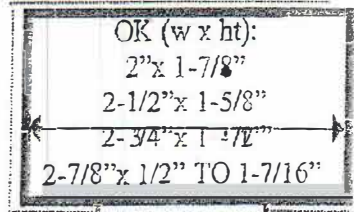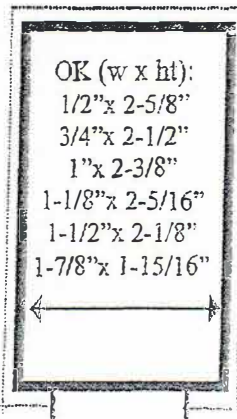


MAXIMUM 2-7/8"
CROSS SECTION
MAX. 6-1/4"
GRIPPING
SURFACE INCL.
MIN. 1/4"
RECESS ON
EACH SIDE


OTHERS

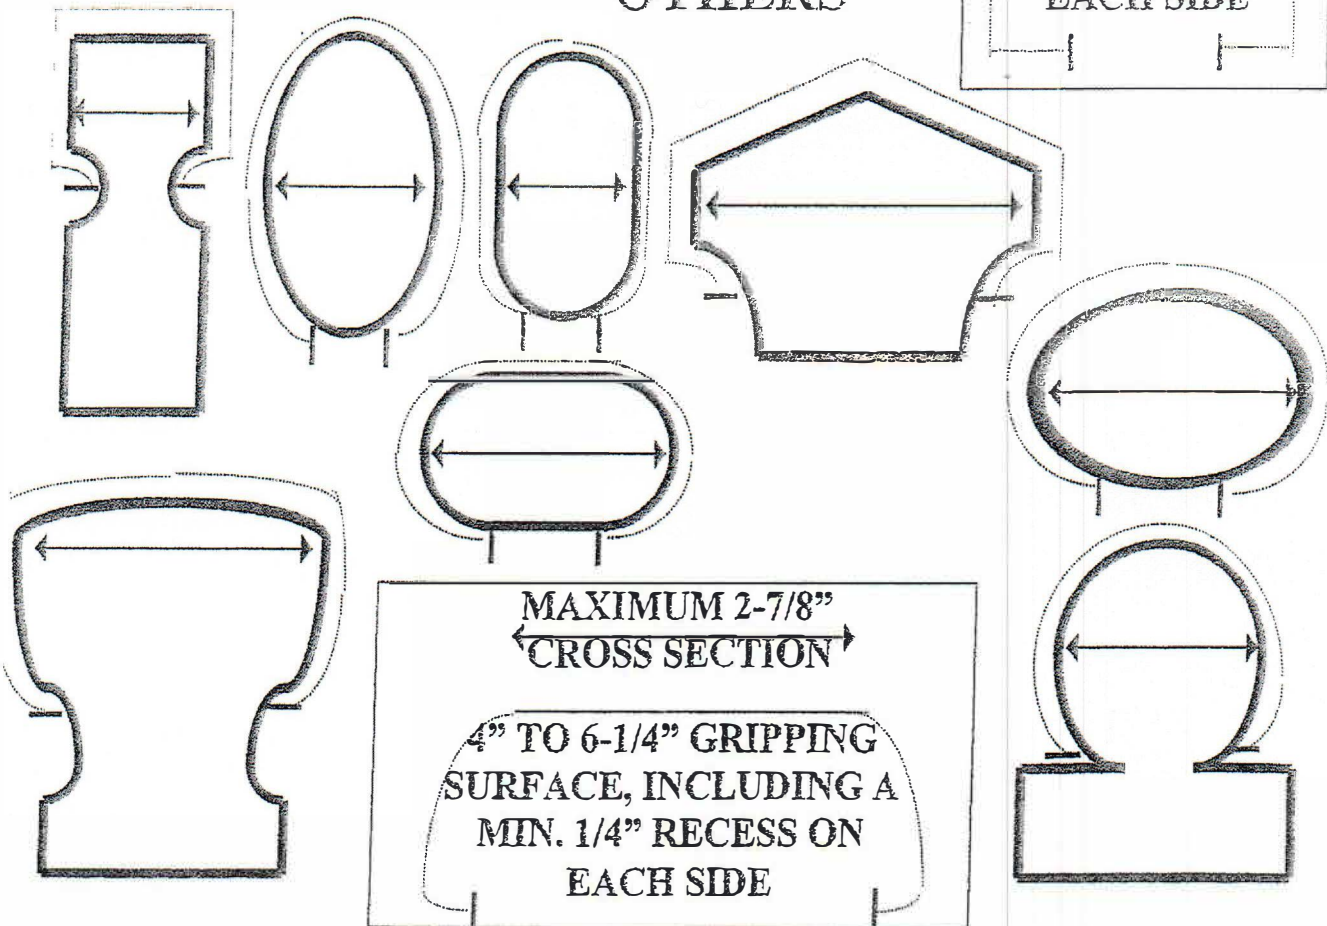

Note: With vinyl or aluminum siding, the band may be bolted directly to the house, Without flashing or removal of siding.

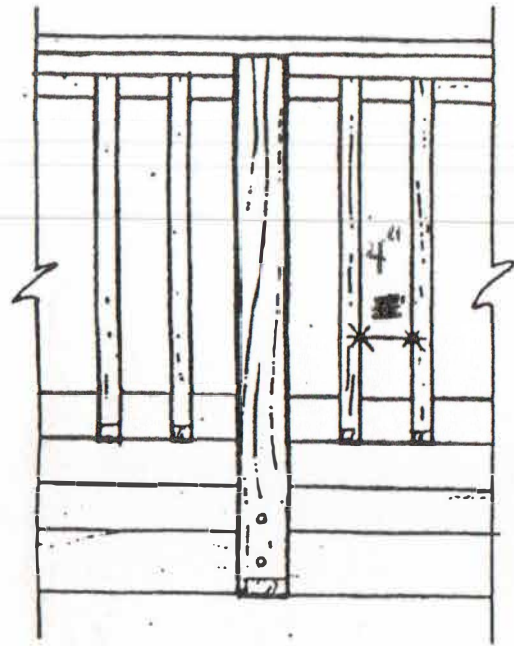

Elevation

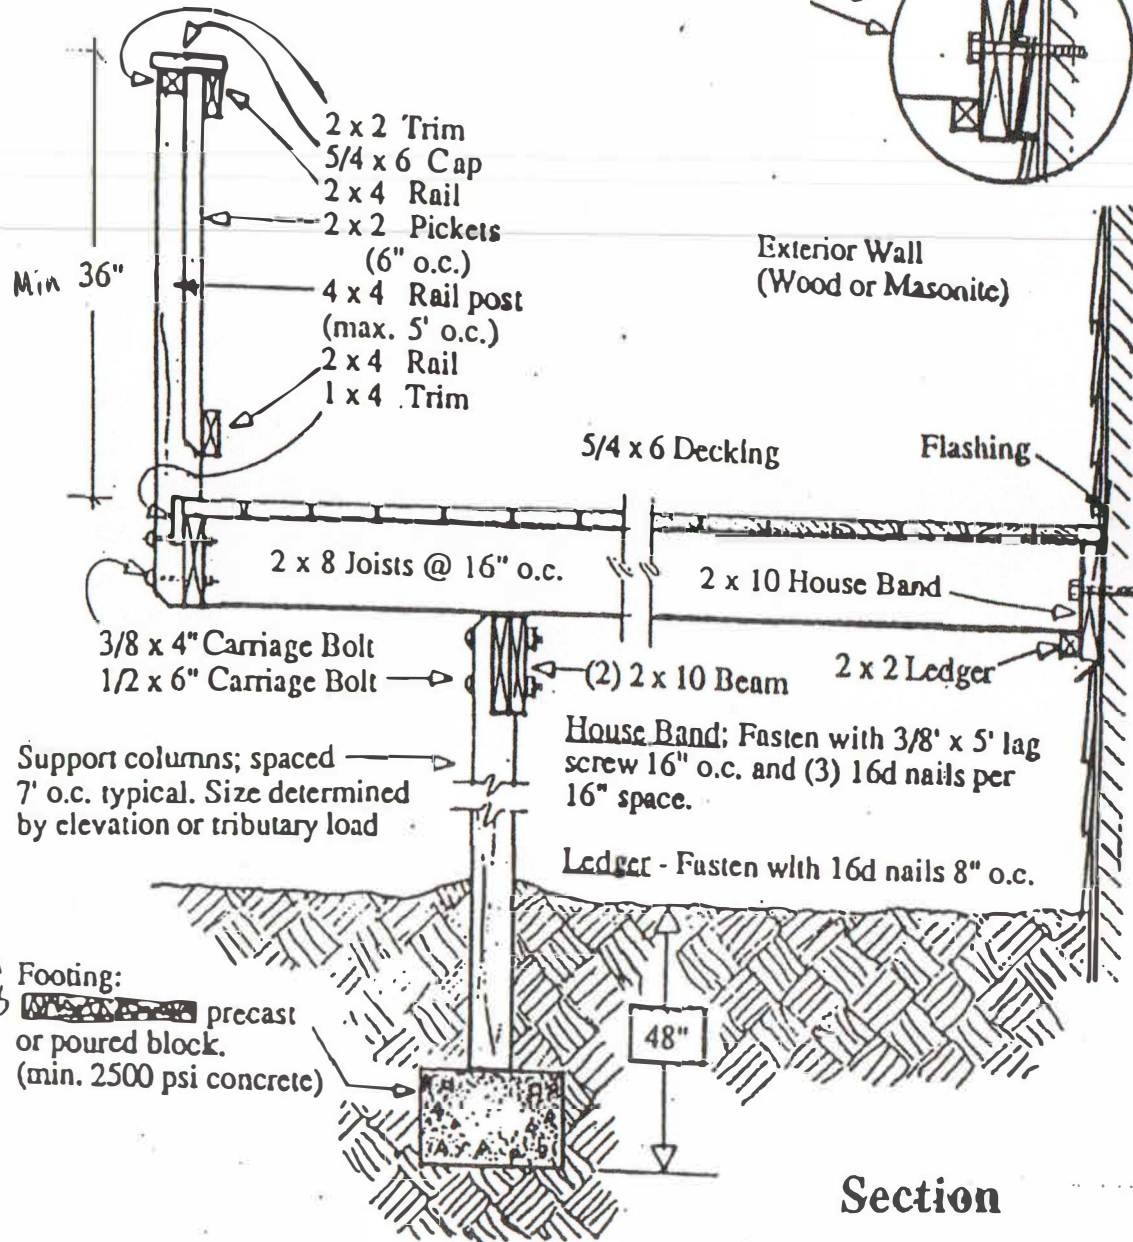

Section

Note: See plan for specific details or special loading conditions.

Wisconsin Division of Safety and Buildings Wisconsin Stats. 101.63, 101.73	WISCONSIN UNIFORM BUILDING PERMIT APPLICATION Instructions on back of second ply. The information you provide may be used by other government agency programs [(Privacy Law, s. 15.04 (1)(m))]	Application No. _____ Parcel No. _____
--	---	---

PERMIT REQUESTED	Constr. HVAC Electric Plumbing Erosion Control Other: _____
Owner's Name _____	Mailing Address _____ Tel. _____
Contractor Name & Type _____	Lic/Cert# _____ Mailing Address _____ Tel. & Fax _____
Dwelling Contractor (Constr.) _____	
Dwelling Contr. Qualifier _____	The Dwelling Contr. Qualifier shall be an owner, CEO, COB or employee of the Dwelling Contr.
HVAC _____	
Electrical _____	
Plumbing _____	

PROJECT LOCATION	Lot area	Sq.ft.	One acre or more of soil will be disturbed	_____ 1/4, _____ 1/4, of Section _____, T _____ N, R _____ E (or) W
Building Address _____		Subdivision Name _____		Lot No. _____ Block No. _____
Zoning District(s) _____		Zoning Permit No. _____		Setbacks: Front _____ ft. Rear _____ ft. Left _____ ft. Right _____ ft.

1. PROJECT	3. OCCUPANCY	6. ELECTRIC	9. HVAC EQUIP.	12. ENERGY SOURCE																								
New Repair Alteration Raze Addition Move Other: _____	Single Family Two Family Garage Other: _____	Entrance Panel Amps: _____ Underground Overhead 7. WALLS Wood Frame Steel <input type="checkbox"/> ICF <input type="checkbox"/> Timber/Pole <input type="checkbox"/> Other: _____	Furnace Radiant Basebd Heat Pump Boiler Central AC <input type="checkbox"/> Fireplace Other: _____	<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <td style="width:10%;">Fuel</td> <td style="width:10%;">Nat Gas</td> <td style="width:10%;">LP</td> <td style="width:10%;">Oil</td> <td style="width:10%;">Elec</td> <td style="width:10%;">Solid</td> <td style="width:10%;">Solar</td> </tr> <tr> <td>Space Htg</td> <td><input type="checkbox"/></td> <td><input type="checkbox"/></td> <td><input type="checkbox"/></td> <td><input type="checkbox"/></td> <td><input type="checkbox"/></td> <td><input type="checkbox"/></td> </tr> <tr> <td>Water Htg</td> <td><input type="checkbox"/></td> <td><input type="checkbox"/></td> <td><input type="checkbox"/></td> <td><input type="checkbox"/></td> <td><input type="checkbox"/></td> <td><input type="checkbox"/></td> </tr> </table>	Fuel	Nat Gas	LP	Oil	Elec	Solid	Solar	Space Htg	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	Water Htg	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>			
Fuel	Nat Gas	LP	Oil	Elec	Solid	Solar																						
Space Htg	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>																						
Water Htg	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>																						
2. AREA INVOLVED (sq ft)	4. CONST. TYPE	5. STORIES	8. USE	10. SEWER																								
<table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th></th> <th>Unit 1</th> <th>Unit 2</th> <th>Total</th> </tr> </thead> <tbody> <tr> <td>Unfin. Bsmt</td> <td></td> <td></td> <td></td> </tr> <tr> <td>Living Area</td> <td></td> <td></td> <td></td> </tr> <tr> <td>Garage</td> <td></td> <td></td> <td></td> </tr> <tr> <td>Deck</td> <td></td> <td></td> <td></td> </tr> <tr> <td>Totals</td> <td></td> <td></td> <td></td> </tr> </tbody> </table>		Unit 1	Unit 2	Total	Unfin. Bsmt				Living Area				Garage				Deck				Totals				Site-Built Mfd. per WI UDC Mfd. per US HUD 5. STORIES 1-Story 2-Story Other: Plus Basement	Seasonal Permanent Other: _____	<input type="checkbox"/> Municipal <input type="checkbox"/> Sanitary Permit# _____	11. WATER <input type="checkbox"/> Municipal <input type="checkbox"/> On-Site Well
	Unit 1	Unit 2	Total																									
Unfin. Bsmt																												
Living Area																												
Garage																												
Deck																												
Totals																												
				13. HEAT LOSS _____ BTU/HR Total Calculated Envelope and Infiltration Losses ("Maximum Allowable Heating Equipment Output" on Energy Worksheet; "Total Building Heating Load" on Rescheck report)																								
				14. EST. BUILDING COST w/o LAND \$ _____																								

I understand that I am subject to all applicable codes, statutes and ordinances and with the conditions of this permit; understand that the issuance of the permit creates no legal liability, express or implied, on the state or municipality; and certify that all the above information is accurate. If one acre or more of soil will be disturbed, I understand that this project is subject to ch. NR 151 regarding additional erosion control and stormwater management and the owner shall sign the statement on the back of the permit if not signing below. I expressly grant the building inspector, or the inspector's authorized agent, permission to enter the premises for which this permit is sought at all reasonable hours and for any proper purpose to inspect the work which is being done.

I vouch that I am or will be an owner-occupant of this dwelling for which I am applying for an erosion control or construction permit without a Dwelling Contractor Certification and have read the cautionary statement regarding contractor responsibility on the reverse side of the last ply.

APPLICANT (Print:) _____ **Sign:** _____ **DATE** _____

APPROVAL CONDITIONS This permit is issued pursuant to the following conditions. Failure to comply may result in suspension or revocation of this permit or other penalty. **See attached for conditions of approval.**

ISSUING JURISDICTION	Town of _____ Village of _____ City of _____ County of _____ State--> _____	State-Contracted Inspection Agency#: _____	Municipality Number of Dwelling Location _____
-----------------------------	---	--	--

FEES:	PERMIT(S) ISSUED	WIS PERMIT SEAL #	PERMIT ISSUED BY:
Plan Review \$ _____ Inspection \$ _____ Wis. Permit Seal \$ _____ Other \$ _____ Total \$ _____	Construction HVAC Electrical Plumbing Erosion Control		Name _____ Date _____ Tel. _____ Cert No. _____

SBD-5823(R.10/08) Distribute: Ply 1 – Issuing Jurisdiction; Ply 2- Issuer forwards to State w/in 30 days; Ply 3- Inspector; Ply 4- Applicant

Cautionary Statement To Owners Obtaining Building Permits

101.65(lr) of the Wisconsin Statutes requires municipalities that enforce the Uniform Dwelling Code to provide an owner who applies for a building permit with a statement advising the owner that:

If the owner hires a contractor to perform work under the building permit and the contractor is not bonded or insured as required under Ss. 101.654 (2) (a), the following consequences might occur:

(a) The owner may be held liable for any bodily injury to or death of others or for any damage to the property of others that arises out of the work performed under the building permit or that is caused by any negligence by the contractor that occurs in connection with the work performed under the building permit.

(b) The owner may not be able to collect from the contractor damages for any loss sustained by the owner because of a violation by the contractor of the one and two family dwelling code or an ordinance enacted under Ss. 101.654(1) (a), because of any bodily injury to or death of others or damage to the property of others that arises out of the work performed under the building permit or because of any bodily injury to or death of others or damage to the property of others that is caused by any negligence by the contractor that occurs in connection with the work performed under the building permit.

Additionally: Wisconsin Statute: 101.6 Compliance and penalties. (1) "Every builder, designer and owner shall use building materials, methods and equipment which are in conformance with the one and two family dwelling code."

Consequently: If the owner signs the Permit Application, the owner is held responsible for any code violation, Orders for Correction and/or citation(s) that may be issued in association with the Permit.

If a contractor signs the Permit as agent for the owner, the contractor is held responsible for any code violations, Orders for Correction and/or citation(s) that may be issued in association with the Permit.

Owner Signature: _____ Date: ____/____/____

INSTRUCTIONS

The owner, builder or agents shall complete the application form down through the Signature of Applicant block and submit it and building plans and specifications to the enforcing municipality. Permit application data is used for statewide statistical gathering on new one- and two-family dwellings, as well as for local code administration. **Please type or use ink and press firmly with multi-ply form.**

PERMIT REQUESTED

- Check off type of Permit Requested, such as structural, HVAC, Electrical or Plumbing.
- Fill in owner's current Mailing Address and Telephone Number.
- If the project will disturb one acre or more of soil, the project is subject to the additional erosion control and stormwater provisions of ch. NR 151 of the WI Administrative Code. Checking this box will satisfy the related notification requirements of ch. NR 216.
- Fill in Contractor and Contractor Qualifier Information. Per s. 101.654 (1) WI Stats., an individual taking out an erosion control or construction permit shall enter his or her dwelling contractor certificate number, and name and certificate number of the dwelling contractor qualifier employed by the contractor, unless they reside or will reside in the dwelling. Per s. 101.63 (7) Wis. Stats., the master plumber name and license number must be entered before issuing a plumbing permit.

PROJECT LOCATION

- Fill in Building Address (number and street or sufficient information so that the building inspector can locate the site).
- Local zoning, land use and flood plain requirements must be satisfied before a building permit can be issued. County approval may be necessary.
- Fill in Zoning District, lot area and required building setbacks.

PROJECT DATA - Fill in all numbered project data blocks (1-14) with the required information. All data blocks must be filled in, including the following:

2. Area (involved in project):
 - Basements - include unfinished area only
 - Living area - include any finished area including finished areas in basements
 - Two-family dwellings - include separate and total combined areas
3. Occupancy - Check only "Single-Family" or "Two-Family" if that is what is being worked on. In other words, do not check either of these two blocks if only a new detached garage is being built, even if it serves a one or two family dwelling. Instead, check "Garage" and number of stalls. If the project is a community based residential facility serving 3 to 8 residents, it is considered a single-family dwelling.
9. HVAC Equipment - Check only the major source of heat, plus central air conditioning if present. Only check "Radiant Baseboard" if there is no central source of heat.
10. Plumbing - A building permit cannot be issued until a sanitary permit has been issued for any new or affected existing private onsite wastewater treatment system.
14. Estimated Cost - Include the total cost of construction, including materials and market rate labor, but not the cost of land or landscaping.

SIGNATURE - Sign and date this application form. If you do not possess the Dwelling Contractor certification, then you will need to check the owner-occupancy statement for any erosion control or construction permits.

CONDITIONS OF APPROVAL - The authority having jurisdiction uses this section to state any conditions that must be complied with pursuant to issuing the building permit.

ISSUING JURISDICTION: This must be completed by the authority having jurisdiction.

- Check off Jurisdiction Status, such as town, village, city, county or state and fill in Municipality Name
- Fill in State Inspection Agency number only if working under state inspection jurisdiction.
- Fill in Municipality Number of Dwelling Location
- Check off type of Permit Issued, such as construction, HVAC, electrical or plumbing.
- Fill in Wisconsin Uniform Permit Seal Number, if project is a new one- or two-family dwelling.
- Fill in Name and Inspector Certification Number of person reviewing building plans and date building permit issued.

PLEASE RETURN SECOND PLY WITHIN 30 DAYS AFTER ISSUANCE TO (You may fold along the dashed lines and insert this form into a window envelope.):

Safety & Buildings Division
P O Box 2509
Madison, WI 53701-2509

GENERAL REQUIREMENTS OF DECK CONSTRUCTION
ACKNOWLEDGEMENT OF UNDERSTANDING OF RULES & REGULATIONS
PER SAFETY & PROFESSIONAL SERVICE CODE OF
WISCONSIN STATE STATUTES

I have read and understand Chapters SPS 320 to 325, Appendix B, of the Safety & Professional Services Code of Wisconsin State Statutes and agree that, I, or my contractor will adhere to them.

Signature of Applicant

Date

Printed Name of Applicant



Master

Decks are the location of many occupant deaths and injuries, many due to structural deficiencies such as inadequate connections of ledger boards, guards and posts. This code provides various prescriptive, or cookbook, methods of complying with the code requirements, that are typically conservative because of the unknown, specific project conditions. It also allows for individually engineered designs that take advantage of all specific project conditions, as well as alternate generic designs that are based on the UDC loads, materials and methods of design. These generic methods can include tables, calculators, guides and other tools. Their limitations must also be followed. In some cases, these limitations will be more restrictive than that UDC, but are necessary for the overall designs to perform properly. With proper documentation, conservative substitutions or engineered substitutions may be allowed. In other cases, these alternate generic designs may differ from the UDC for issues that are not related to the need for the overall design to work. In such cases, per SPS 320.01, the UDC provisions would be the minimum and maximum enforced provisions.

Appendix B provides an acceptable method of designing a deck, at the owner's option. It is mainly based on the 2012 American Wood Council's standard, Design for Code Acceptance 6 (DCA-6) – Prescriptive Residential Wood Deck Construction Guide. Note that DCA-6 is based on the 2012 International Residential Code. Appendix C of the UDC provides supplementary acceptable methods of designing a deck.

Designs based on DCA-6 are also acceptable.

Following is Appendix B with commentary in shaded italicized text.

APPENDIX B


Section	Page	Section	Page
1 GENERAL REQUIREMENTS	233	9 LEDGER-BOARD FASTENERS	243
2 FOOTINGS, AND POST CONNECTIONS	234	10 FREE-STANDING DECKS	245
3 POSTS AND POST-T O-BEAM CONNECTIONS	236	11 LATERAL SUPPORT	246
4 BEAMS	237	12 DECKING	248
5 JOISTS	238	13 GUARD AND POSTS	248
6 JOIST-T O-BEAM CONNECTIONS	240	14 STAIRS	250
7 JOIST HANGERS	240	15 FRAMING PLAN	254
8 LEDGER ATTACHMENTS	241		

SECTION 1: GENERAL REQUIREMENTS

1. All lumber, including for decking, must be pressure-preservative-treated and must be either Douglas fir/larch, hemlock/fir, spruce/pine/fir (SPF), or southern pine, of grade #2 or better ± unless a naturally durable species such as a western red cedar is used. Lumber in contact with the ground must be rated as "ground-contact." The lumber must be identified by the grade mark of, or certificate of inspection issued by, a professional lumber-grading or inspection bureau or agency (www.alsc.org).

Note: Not all treated lumber is rated for ground contact. See Table C-1 in Appendix C for further information.

See SPS 321.10 of the UDC Commentary for additional information on treated lumber.

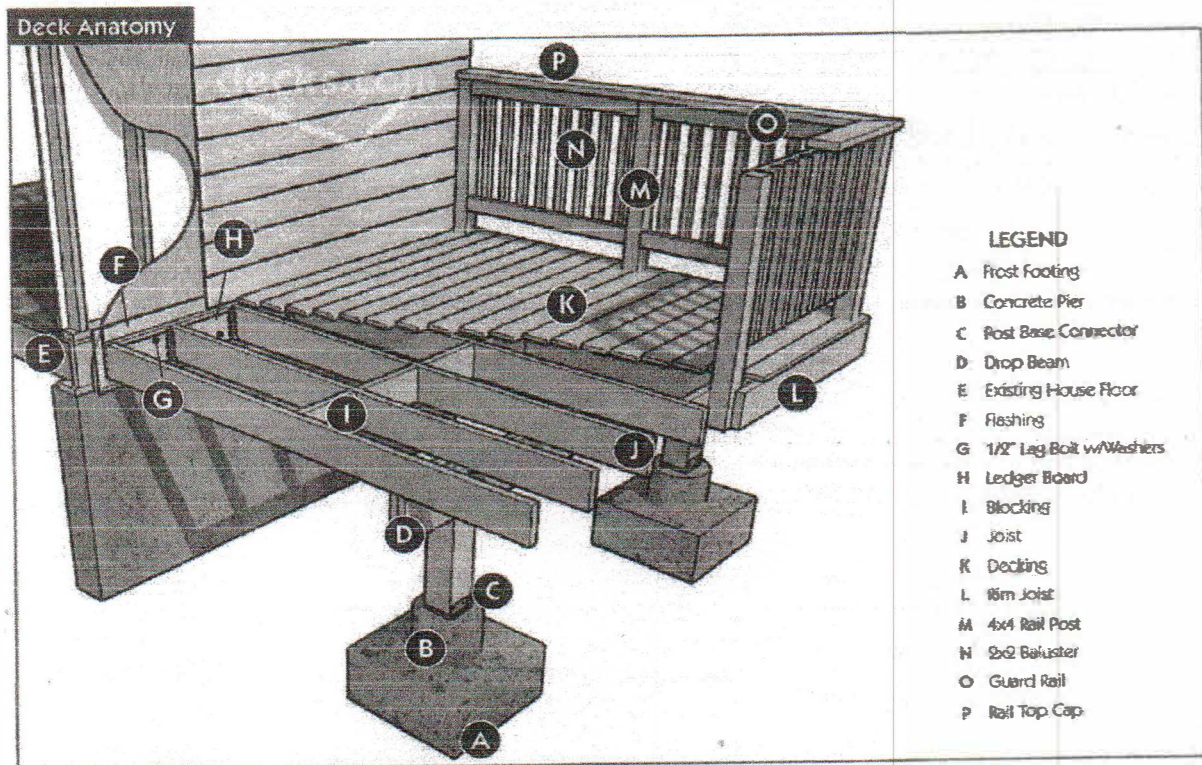

2. Wood-plastic composites must bear a label indicating their performance criteria and compliance with ASTM D7032.

Note: Wood-plastic composites are materials composed of wood fibers or powder that is bound with plastic and used typically as decking and elements of a guard or handrail.

Note: When using a wood-plastic composite, exercise caution as some composite members do not have the same capabilities as their equivalent wood sizes.

3. Nails must be threaded, which includes ring-shanked (annular-grooved) and spiral-grooved.

Note: A 1/8 inch pilot hole is recommended for all toe-nailing locations.

Although not specifically required by the UDC, this requirement is included to address smooth-shanked nails "backing out" of wood due to moisture cycling.

4. All fasteners must be galvanized steel, stainless steel, or approved for use with preservative-treated lumber .

5. Throughout this document, 1/2 inch-diameter bolts and lag screws are specified for various connections. Edge distance and spacing requirements are based on 1/2 inch-diameter fasteners. If larger (or smaller) fasteners are specified, edge distance and spacing need to be adjusted.

6. Carriage-bolts may be substituted where through-bolts are specified, if carriage-bolt washers are installed at the bolt head.

Note: Carriage-bolt washers have square holes.

7. Hardware, including joist hangers or post anchors, must be galvanized steel with 1.85 ounces of zinc per square foot (G-185 coating), or stainless steel. All fasteners that are used with any hardware must be the same material as the

hardware. All hardware must be installed in accordance with any instructions from the manufacturer.

Note: For galvanized steel, look for product lines such as "Zmax," "Triple Zinc," or "Gold Coat."

Note: Galvanized steel is not compatible with stainless steel, which can result in rapid corrosion and structural failure.

Note: Hardware and fasteners that are beneath a hot tub which uses salt-water disinfection should be stainless steel, grade 304 or 316.

Although the UDC does not require corrosion protection of connectors, the manufacturers of such connectors and treated wood typically have code-enforceable requirements for connectors used in exterior environments and with treated wood.

8. Every deck must have an electrical outlet along the perimeter of the deck and within 6.5 feet of the floor in accordance with NEC section 210.52(E)(3). See ch. SPS 316 of the Wisconsin Administrative Code for requirements about installing electrical wiring.
9. A deck constructed in accordance with these standards is not approved for concentrated loads that exceed 40 pounds per square foot (psf), such as from privacy screens, planters, built-in seating, hot tubs, stairs for multiple-level decks, or from snow-drift loads or sliding-snow loads. Engineering analysis is needed for these loads.

Note: See Appendix C for features of a deck which are somewhat uncommon or which have more complexity than is addressed in this Appendix ± such as design values for joists consisting of western cedar or red pine, framing details around chimneys and bay windows, or ledger boards for metal-plate-connected wood floor trusses. Appendix C also includes reference material, such as more-detailed specifications for fasteners.

10. Specifications for fasteners and hardware. All nails must meet the requirements of ASTM F1667. Wood screws must meet the requirements of ANSI/ASME B18.6.1. Bolts and lag screws must meet the requirements of ANSI/ASME B18.2.1.

Fasteners to be hot-dipped galvanized must meet the requirements of ASTM A153, *Standard Specification for Zinc Coating (Hot-Dip) on Iron and Steel Hardware*, Class D for fasteners 3/8" diameter and smaller or Class C for fasteners with diameters over 3/8".

Fasteners other than nails and timber rivets may consist of mechanically deposited zinc-coated steel with coating weights in accordance with ASTM B695, Class 55, minimum.

Hardware to be hot-dipped prior to fabrication must meet ASTM A653, *Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process*, G-185 coating. Hardware to be hot-dipped galvanized after fabrication must meet ASTM A123, *Specification for Zinc (Hot-Dip Galvanized) Coatings on Iron and Steel Products*.

11. Safety glazing at decks shall be in accordance with the safety glazing requirements of the Uniform Dwelling Code (UDC).

See SPS 321.05(3) of the UDC for safety glazing requirements for glazing adjacent to doors, tubs and stairs.

Be aware of SPS 321.03(6)(f) that requires any path under a deck from the discharge of an egress window to have a minimum headroom height of 36" by 36" wide for no more than 15' till free of the deck.

SECTION 2: FOOTINGS, AND POST CONNECTIONS

Footings must comply with all of the following:

1. Concrete must be used and must have a minimum compressive strength of 3,000 pounds per square inch.
2. Footing size and thickness must be in accordance with Table 1. (See sections 4 and 5 for determining post spacing and joist length.)
3. Post attachments must be in accordance with Figure 1 except expansion anchors are also permitted ± and any instructions from the manufacturer of the anchor must be followed.

Adhesive anchors may also be used.

4. Post anchors must include a 1-inch-minimum base plate. Steel plates are not required.

If treated lumber is used (as the UDC requires for exterior decks), then per SPS 321.10(2)(f), of the UDC, an elevated post base is not required.

5. Each post must bear directly over the middle one-third of a footing.
6. Footings must bear on solid ground below the frost penetration level or at least 48 inches below finished grade, whichever is deeper. Bearing onto unprepared fill material, organic soil, alluvial soil, or mud is prohibited. The bearing capacity of the soil is presumed to be at least 2000 pounds per square foot (psf), and must be verified by a building inspector prior to placement of concrete.
7. If the edge of a deck footing is closer than 5 feet to an existing house wall, the footing must bear at the same elevation as the existing footing for that wall.

This requirement addresses the lateral soil loads that deck footing may impose on an adjacent foundation wall. Note also that backfill material adjacent to an existing dwelling may not have been properly compacted after being previously disturbed.

8. Construction of footings over utility lines or any service pipe is prohibited.

Note: Call the utility provider before digging.

Table 1
FOOTING SIZE (In Inches)^{1,2,3}

Joist Length		Post Spacing (Measured Center to Center)										
		4'	5'	6'	7'	8'	9'	10'	11'	12'	13'	14'
6'	Corner Footing	8	9	10	11	11	12	12	13	14	14	15
	Intermediate Footing	10	11	12	13	14	15	15	16	17	17	18
	Footing Thickness	6	6	6	6	6	6	6	6	6	6	8
7'	Corner Footing	9	10	11	11	12	13	13	14	15	15	16
	Intermediate Footing	11	12	13	14	15	16	17	17	18	19	19
	Footing Thickness	6	6	6	6	6	6	6	6	8	8	8
8'	Corner Footing	10	10	11	12	13	14	14	15	15	16	17
	Intermediate Footing	12	13	14	15	16	17	18	19	19	20	21
	Footing Thickness	6	6	6	6	6	6	8	8	8	8	8
9'	Corner Footing	10	11	12	13	14	14	15	16	16	17	18
	Intermediate Footing	12	14	15	16	17	18	19	20	20	21	22
	Footing Thickness	6	6	6	6	6	8	8	8	8	8	8
10'	Corner Footing	10	12	12	13	14	15	16	16	17	18	18
	Intermediate Footing	13	14	15	17	18	19	20	21	21	22	23
	Footing Thickness	6	6	6	6	8	8	8	8	8	8	10
11'	Corner Footing	11	12	13	14	15	16	16	17	18	19	19
	Intermediate Footing	13	15	16	17	19	20	21	22	22	23	24
	Footing Thickness	6	6	6	6	8	8	8	8	8	10	10
12'	Corner Footing	11	12	14	15	15	16	17	18	19	19	20
	Intermediate Footing	14	15	17	18	19	20	21	22	23	24	25
	Footing Thickness	6	6	6	8	8	8	8	8	10	10	10
13'	Corner Footing	12	13	14	15	16	17	18	19	19	20	21
	Intermediate Footing	14	16	17	19	20	21	22	23	24	25	26
	Footing Thickness	6	6	6	8	8	8	8	10	10	10	10
14'	Corner Footing	12	13	15	16	17	18	18	19	20	21	22
	Intermediate Footing	15	17	18	19	21	22	23	24	25	26	27
	Footing Thickness	6	6	8	8	8	8	10	10	10	10	10
15'	Corner Footing	12	14	15	16	17	18	19	20	21	22	22
	Intermediate Footing	15	17	19	20	21	23	24	25	26	27	28
	Footing Thickness	6	6	8	8	8	10	10	10	10	10	12
16'	Corner Footing	13	14	15	17	18	19	20	20	21	22	23
	Intermediate Footing	16	18	19	21	22	23	25	26	27	28	29
	Footing Thickness	6	8	8	8	8	10	10	10	10	12	12

¹ All footing sizes are base diameters².


² For square footings, insert the diameter (d) into the following formula: $\sqrt{((d/2)^2 \times \pi)}$. This number will give you the square dimension and must be rounded up to the nearest inch.

³ Joist length is the joist span plus any overhang beyond a beam. See section 5.4.

Per Figure 3, this table and Tables 3A & 3B are intended for decks with a single joist span bearing on the beam(s). Free standing decks with three or more beams or ledger-supported decks

with two or more beams are not addressed by this design guide. The County of Fairfax in Virginia (<http://www.fairfaxcounty.gov/dpwes/publications/decks/details.pdf>) offers an acceptable deck design guide that includes multi-joist spans. Wisconsin UDC requirements would also need to be followed.

Figure 1
FOOTINGS

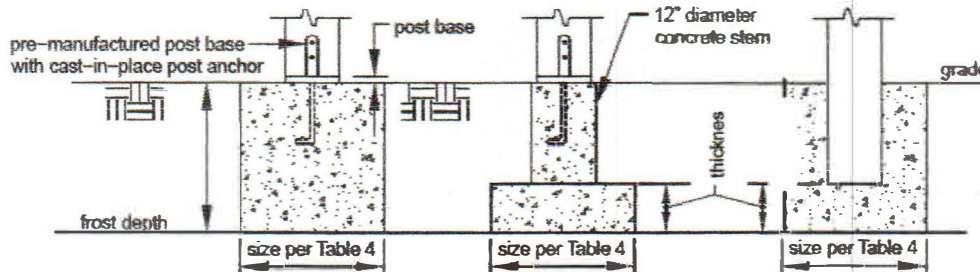

The footings shall be sized per Table 1. Although the middle diagram shows a minimum 12" diameter stem or pier, a narrower stem or pier is acceptable. The diameter of the stem portion must satisfy the concrete side cover requirements for the embedded anchor as specified by the manufacturer of the post base or at least 1-1/2" per the UDC-adopted ACI 318 ss. D.8.2 and 7.7.

For the left-hand and middle options above, the elevation of the post to pier connection may be below grade, in addition to above-grade, if ground contact lumber is used and the post base connector is approved by the manufacturer for burial.

The footing and pier material for all options is concrete per Section 2., except that for the right-hand option shown above, in addition to encasing the wood post with concrete, compacted granular fill may also be used to provide lateral support for the post.

Wisconsin has approved a pin-type foundation system that may also be used to support decks.

SECTION 3: POSTS AND POST-TO-BEAM CONNECTIONS

Posts must comply with all of the following:

1. The post height, measured from the top of the footing to the underside of the beam, must be in accordance with Table 2.

Table 2
MAXIMUM POST HEIGHT

Post Size	Maximum Height
4"x4"	6'
4"x6"	8'
6"x6"	14'

2. Any post supporting a beam splice must be a minimum of 6"x6".

This requirement provides the minimum 3" bearing required by the UDC for each beam supported by the column. Note that a single beam may have some of its plies meet over a smaller post or at the beam's quarter points per footnote 5. to T. 321.22-A of the UDC. The post shall also

be at least as wide as the supported beam.


3. Beams must be attached to posts by the appropriate methods shown in Figure 2. Toe-nailing of beams to posts is prohibited.

Side bolting of beams to columns is not allowed since this design guide does not address tension perpendicular to grain. Note that an engineered connector or a bolted block that provides bottom bearing for the beam would be acceptable.

4. Post caps, as shown in Figure 2, must be specifically designed for 2- or 3-ply beams and the post size used. Attachment must be in accordance with the manufacturer's instructions.
5. It is recommended that cut-ends of posts should be field-treated with a wood preservative. These preservatives can be found in the paint department of most hardware or home-center stores.

Figure 2

POST-TO-BEAM CONNECTIONS

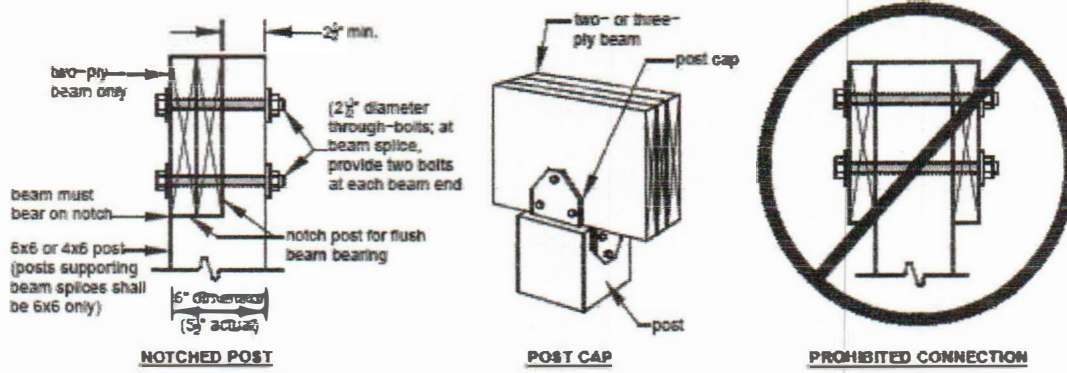

SECTION 4: BEAMS


Beams must comply with all of the following:

1. As shown in Figure 3, the beam-span length is measured between the centerlines of 2 adjacent posts and does not include the overhangs.
2. Beam size is determined using Table 3A or 3B. The depth of flush beams must be greater than or equal to the joist depth.
3. Beams may overhang past the center of the post up to one-fourth of the actual beam span, as shown in Figure 3.
4. Where multiple 2x members are used to assemble a beam, the plies of the beam must be fastened in accordance with Figure 4.

Built-up beams shall be fastened per the UDC Fastener Table and footnotes to Table 321.22-A2.

5. Pressure-preservative-treated glulam beams are permissible for spans longer than those shown in T table 3. However, a design and plan submission is required during the permit application process.

Figure 3
BEAM TYPES

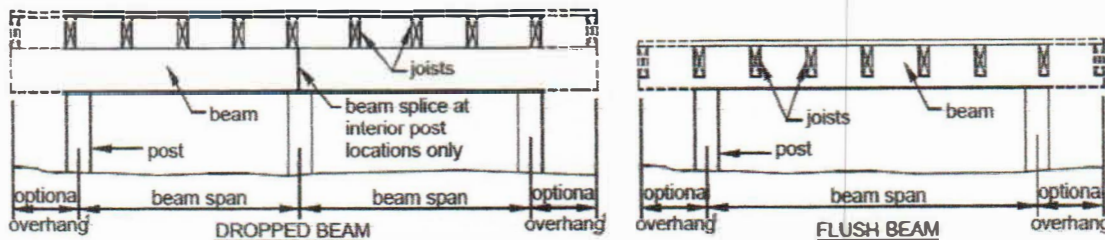

¹The maximum length of the overhang is equal to one-fourth of the actual beam span length (0.25 x beam span).

Table 3A
MAXIMUM BEAM-SPAN LENGTH¹ FOR DOUGLAS FIR/LARCH³, HEM/FIR³, SPRUCE/PINE/FIR⁴
(SPF)³, WESTERN CEDAR, PONDEROSA PINE⁴, AND RED PINE⁴

Joist Span	(Number of Plies)								Beam Size ² ± Inches			
	3x6 (2)2x6	3x8 (2)2x8	3x10 (2)2x10	3x12 (2)2x12	4x6	4x8	4x10	4x12	(3)2x6	(3)2x8	(3)2x10	(3)2x12
≤ 6'	5'-5"	6'-10"	8'-4"	9'-8"	6'-5"	8'-5"	9'-11"	11'-5"	7'-4"	9'-8"	12'-0"	13'-11"
≤ 8'	4'-8"	5'-11"	7'-3"	8'-5"	5'-6"	7'-3"	8'-7"	9'-11"	6'-8"	8'-6"	10'-5"	12'-1"
≤ 10'	4'-2"	5'-4"	6'-6"	7'-6"	4'-11"	6'-6"	7'-8"	8'-10"	6'-0"	7'-7"	9'-4"	10'-9"
≤ 12'	3'-10"	4'-10"	5'-11"	6'-10"	4'-6"	5'-11"	7'-0"	8'-1"	5'-6"	6'-11"	8'-6"	9'-10"
≤ 14'	3'-6"	4'-6"	5'-6"	6'-4"	4'-2"	5'-6"	6'-6"	7'-6"	5'-1"	6'-5"	7'-10"	9'-1"
≤ 16'	3'-1"	4'-1"	5'-1"	5'-11"	3'-11"	5'-2"	6'-1"	7'-0"	4'-9"	6'-0"	7'-4"	8'-6"
≤ 18'	2'-9"	3'-8"	4'-8"	5'-7"	3'-8"	4'-10"	5'-8"	6'-7"	4'-6"	5'-8"	6'-11"	8'-1"

¹ Spans are based on 40 psf live load, 10 psf dead load, normal loading duration, wet service conditions, and deflections of $=L/360$ for main span and $L/180$ for overhang with a 220 lb. point load.

² Beam depth must be equal to or greater than joist depth if joist hangers are used (see Figure 8, Option 3).

³ Incising is assumed.

⁴ Design values based on northern species with no incising assumed.

Per Figure 3, Tables 1 and 3A & 3B are intended for decks with a single joist span bearing on the beam(s). Free standing decks with three or more beams or ledger-supported decks with two or more beams are not addressed by this design guide.

Table 3B
MAXIMUM BEAM-SPAN LENGTH FOR SOUTHERN PINE¹

Joist Span	(Number of Plies)				Beam Size ² ± Inches			
	(2) 2x6	(2) 2x8	(2) 2x10	(2) 2x12	(3) 2x6	(3) 2x8	(3) 2x10	(3) 2x12
≤ 6'	6'-11"	8'-9"	10'-4"	12'-2"	8'-2"	10'-10"	13'-0"	15'-3"
≤ 8'	5'-11"	7'-7"	9'-0"	10'-7"	7'-5"	9'-6"	11'-3"	13'-3"
≤ 10'	5'-4"	6'-9"	8'-0"	9'-5"	6'-8"	8'-6"	10'-0"	11'-10"
≤ 12'	4'-10"	6'-2"	7'-4"	8'-7"	6'-1"	7'-9"	9'-2"	10'-9"
≤ 14'	4'-6"	5'-9"	6'-9"	8'-0"	5'-8"	7'-2"	8'-6"	10'-0"
≤ 16'	4'-3"	5'-4"	6'-4"	7'-6"	5'-3"	6'-8"	7'-11"	9'-4"
≤ 18'	4'-0"	5'-0"	6'-0"	7'-0"	5'-0"	6'-4"	7'-6"	8'-10"


¹ Spans are based on 40 psf live load, 10 psf dead load, normal loading duration, wet service conditions, and deflections of $=L/360$ for main span and $L/180$ for overhang with a 220 lb. point load.

² Beam depth must be equal to or greater than joist depth if joist hangers are used (see Figure 8, Option 3).

Per Figure 3, Tables 1 and 3A & 3B are intended for decks with a single joist span bearing on the beam(s). Free standing decks with three or more beams or ledger-supported decks with two or more beams are not addressed by this design guide.

**Figure 4
BEAM ASSEMBLY**

If a beam is constructed with three-ply, attach each outside member to the inside as shown herein

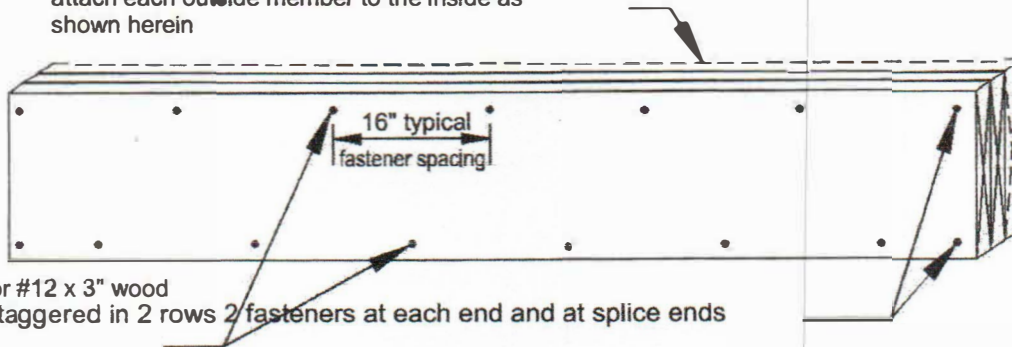

16d nails or #12 x 3" wood screws, staggered in 2 rows 2 fasteners at each end and at splice ends

SECTION 5: JOISTS


Joists must comply with all of the following:

1. The joist-span length is measured between the centerline of bearing at each joist-span end and does not include the overhangs. Use Table 4 to determine the joist size based on span length and joist spacing. See section 12.4 for limits on joist spacing if the decking consists of a wood-plastic composite.
2. See Figures 5 through 7 for joist-span types.
3. Joists must bear at least 3 inches nominal onto beams, unless joist hangers are used in accordance with section 7.

Per the UDC, the minimum joist bearing length is 1-1/2", however joists shall bear on the full width of its supporting beam.

4. Joists may overhang past the center of the beam up to one-fourth of the actual joist span.
5. Provide full-depth 2x blocking or bridging for 2"x10" or deeper joists at intervals not exceeding 8 feet ± except the blocking can be reduced to 60% of the height if placed above a beam, for drainage purposes. Attach the blocking or bridging with (3)10d toe-nails at each end.
6. Attach a continuous rim joist as shown in Figures 5 and 7 unless blocking or bridging is provided for each joist at the beam where a joist overhang begins. Attach the rim joist to the end of each joist with (3)10d nails or (3)#10 by 3-inch wood screws.

Note that if the wood guardrail design of Figure 24 is used, then a minimum 2x8 rim joist will be required to accommodate the proper bolting of the 4x4 guard post.

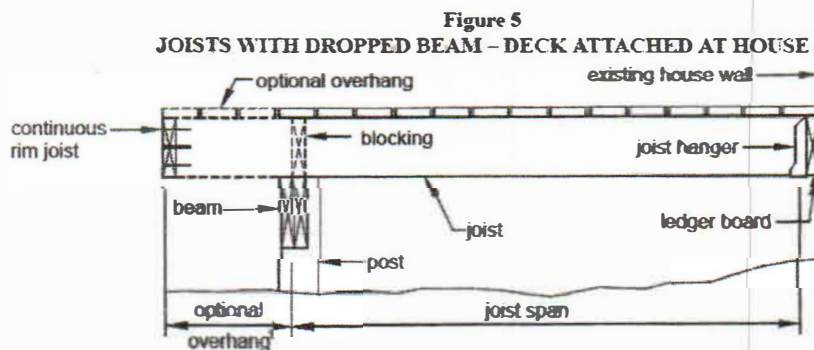

¹The maximum length of the overhang is equal to one-fourth of the actual joist span length (0.25 x joist span).

Figure 6
JOISTS WITH FLUSH BEAM – DECK ATTACHED AT HOUSE


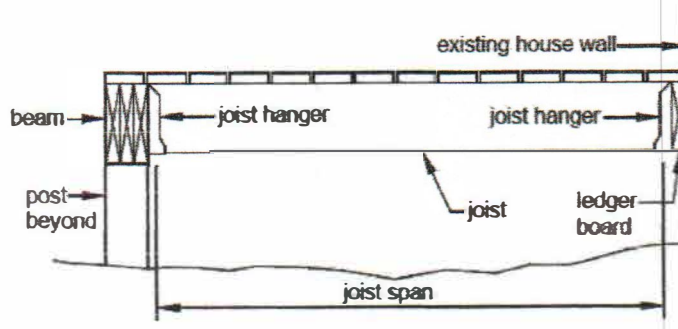


Figure 7
JOISTS WITH TWO DROPPED BEAMS/FREE-STANDING DECK
 (See section 10 for more information.)

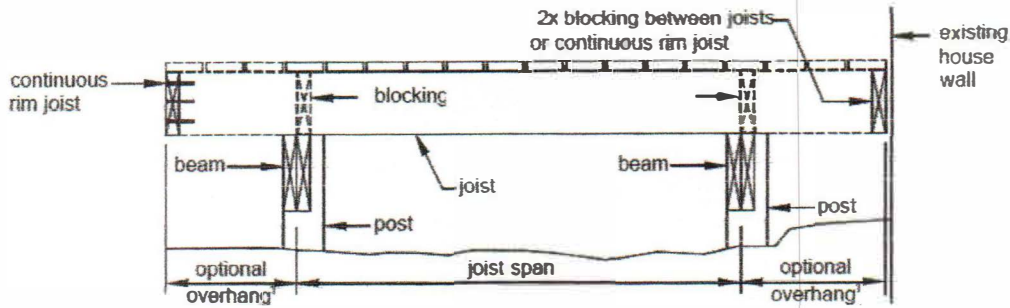

¹The maximum length of the overhang is equal to one-fourth of the actual joist span length (0.25 x joist span).

Table 4
MAXIMUM JOIST-SPAN LENGTH¹

Joist Spacing (on center)	Joist Size	Douglas Fir/Larch, Hem/Fir, SPF ²		Southern Pine	
		Without Overhang	With Over- hangs	Without Overhang	With Over- hangs
12"	2"x6"	9'-1"	8'-1"	9'-6"	8'-7"
	2"x8"	12'-6"	9'-5"	13'-1"	10'-1"
	2"x10"	15'-8"	13'-7"	16'-2"	14'-6"
	2"x12"	18'-0"	18'-0"	18'-0"	18'-0"
16"	2"x6"	8'-3"	8'-0"	8'-7"	8'-7"
	2"x8"	11'-1"	9'-5"	11'-10"	10'-1"
	2"x10"	13'-7"	13'-7"	14'-0"	14'-0"
	2"x12"	15'-9"	15'-9"	16'-6"	16'-6"
24"	2"x6"	6'-9"	6'-9"	7'-6"	7'-6"
	2"x8"	9'-1"	9'-1"	9'-8"	9'-8"
	2"x10"	11'-1"	11'-1"	11'-5"	11'-5"
	2"x12"	12'-10"	12'-10"	13'-6"	13'-6"

¹ Spans are based on 40 psf live load, 10 psf dead load, normal loading duration, wet service conditions, and deflections of $=L/360$ for main span and $L/180$ for overhang with a 220 lb. point load.


² Incising is assumed.

See Appendix C Table C-2 for other wood species. If diagonal decking or composite decking is used, closer joist spacing may be necessary.

SECTION 6: JOIST – T O – BEAM CONNECTIONS

Joists must be attached to beams in accordance with Figure 8 and all of the following:

1. Use Options 1 or 2 if joists bear on a dropped beam.
2. Use Option 3 if joists bear at a flush beam; see section 7 for hanger requirements.
3. Mechanical fasteners or hurricane clips must have a minimum capacity of 100 pounds in both uplift and

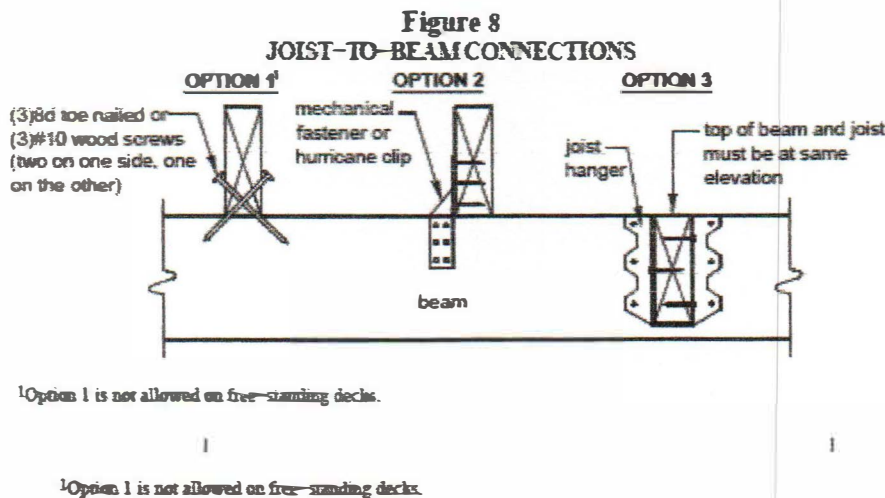

SECTION 7: JOIST HANGERS

Joist hangers must comply with all of the following:

1. The joist-hanger depth (d , as shown in Figure 9) must be at least 60 percent of the joist depth.
2. The manufactured width of the joist hanger must accommodate the number of plies being carried.
3. Do not bend hanger flanges to accommodate field conditions.

Unless permitted by the manufacturer.

4. For joist hangers that are fastened to a ledger board, screws which are recommended by the manufacturer must be used. All other fasteners are permitted to be nails. The number of fasteners and the manner in which they are used must be as specified by the manufacturer.

The requirement for screwing joist hangers into the ledger board is to address lateral loads imposed on the deck.

5. Use joist hangers with inside flanges if clearances to the edge of the beam or ledger board dictate.
6. Clip-angles or brackets used to support framing members in lieu of joist hangers are prohibited.
7. Joists must not frame in from both sides of the same beam. Engineering analysis is needed if more beams are needed than are shown in Figures 5 to 7.
8. Each joist hanger must have the minimum capacity listed in Table 5.

Bottom bearing joist hangers are required because tension perpendicular to grain is not addressed by this design guide.

Figure 9
JOIST HANGERS

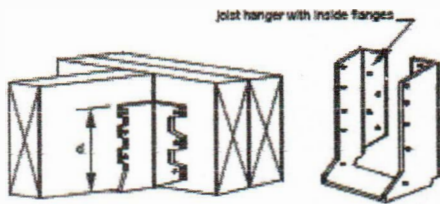


Table 5
JOIST HANGER DOWNLO. AD

Joist Size	Minimum Capacity, lbs
2"x6"	500
2"x8"	500
2"x10"	600
2"x12"	700

SECTION 8: LEDGER ATTACHMENTS

General requirements. Ledger boards must be attached to the existing house in accordance with all of the following and section 9. Compliance is critical to ensure the safety and structural stability of your deck.

1. The ledger-board depth must be greater than or equal to the depth of the deck joists, but not less than a 2"x8".
2. The ledger board must be attached in accordance with one of the conditions shown in Figures 11 through 13 ± except if metal-plate-connected wood floor trusses were used in the house, see the text below for manufactured wood trusses.
3. The existing band board on the house must be capable of supporting the deck. If this cannot be verified or if existing conditions differ from the details here, then a free-standing deck or an engineered design is required.
4. The top of the ledger board and the top of the deck joists must be at the same elevation.

The requirement to locate the ledger board and the top of the deck joists at the same elevation is intended to avoid tripping hazards and ensure proper joist hanger installation. A designer may wish to change these elevations in order to properly fasten to either the dwelling bandboard or foundation and accommodate either having the decking level with, or dropped from, the dwelling floor no more than 8". It is acceptable to locate the top of the ledger board even with the decking, as long as the joist hangers are installed properly and decking is fastened to blocking as needed.

Wood I-joists. Many homes are constructed with wood I-joists, as shown in Figure 10. Rather than utilize a 2x band board, these systems are often constructed with a minimum 1-inch-thick engineered wood product (EWP) band board capable of supporting a deck. If a minimum 1-inch EWP or 2x band board is not present, then a free-standing deck is required, as addressed in section 10.

Figure 10: WOOD I-JOISTS



Manufactured wood trusses. A metal-plate-connected wood truss (MPCWT) is an engineered, prefabricated structural component that is designed for each specific application. MPCWT systems that are used in residential floors are often installed with a 2"x4" lumber "ribbon" board at the ends of the trusses to tie the ends of the trusses together (see Detail 1 in Appendix C.). The ribbon board, by itself, is not intended to support the deck ledger and deck. Installing a residential deck where the floor for the house uses a MPCWT system must be in accordance with a standard detail provided by the truss designer, a corresponding detail in section 7 of Appendix C, or a full plan submission ± unless the deck is free-standing as addressed in section 10.

Siding and flashing. Flashing must be installed in accordance with all of the following:

1. The exterior finish, such as house siding, must be removed in the area for the ledger board prior to the installation of the ledger board.
2. Continuous flashing with a drip edge, as shown in Figure 11, is required at a ledger board that is attached to wood-framed construction. Caulking is needed with the flashing at a threshold to prevent water intrusion due to splash from the deck or due to melting snow and ice.

See SPS 321.24 of the UDC Commentary for a flashing and caulking detail of a door threshold at a deck

3. Flashing must be a corrosion-resistant metal having a minimum nominal 0.019-inch thickness ± such as galvanized steel coated with 1.85 ounces of zinc per square foot (G-185 coating), copper (attached using copper nails only), or stainless steel ± or must be a UV-resistant plastic recommended by its manufacturer for this use. Do not use aluminum in direct contact with lumber treated with preservatives that contain copper, such as ACQ, copper azole, or ACZA.

Figure 11
ATTACHMENT OF LEDGER BOARD TO BAND BOARD OR BAND JOIST

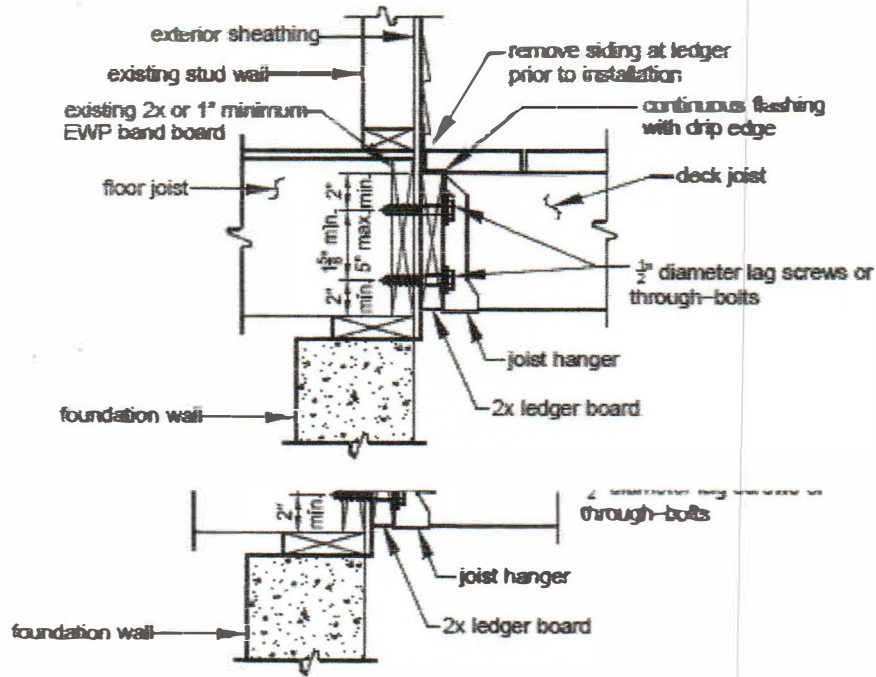


Figure 12
ATTACHMENT OF LEDGER BOARD TO SOLID FOUNDATION



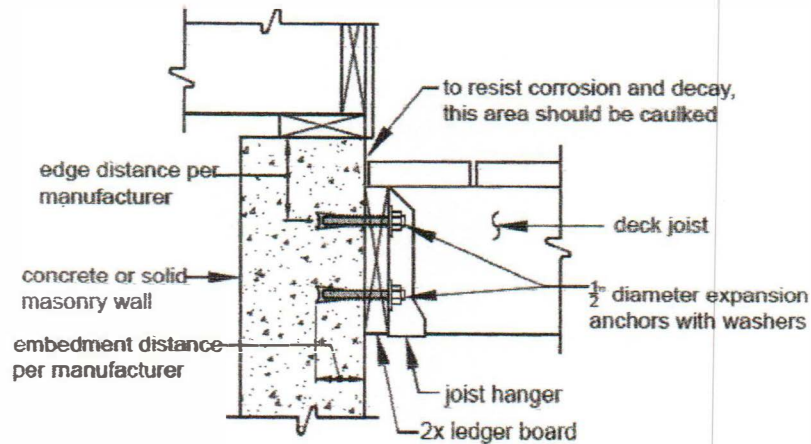


Figure 13
ATTACHMENT OF LEDGER BOARD TO HOLLOW FOUNDATION

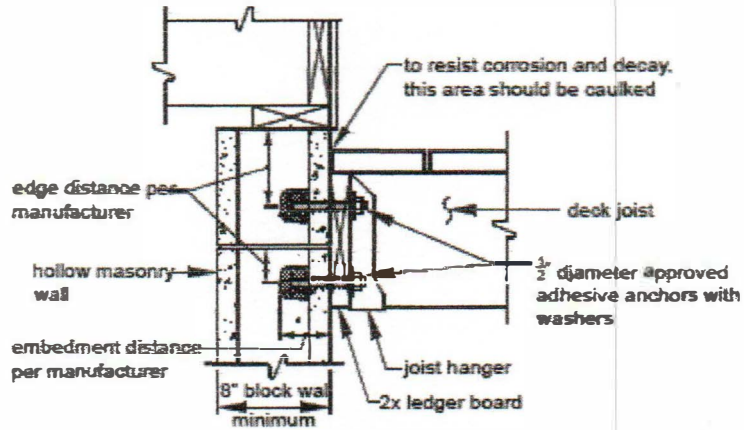

Prohibited ledger attachments. Attaching a ledger board to or through an exterior veneer such as brick or stone, or to or through a masonry chimney, or to a house overhang ± as shown below ± are prohibited. In such cases, the deck must be free-standing, as addressed in section 10. Attaching a ledger board to a house overhang is allowed if supported by engineering.


Figure 14
PROHIBITED LEDGER ATTACHMENTS

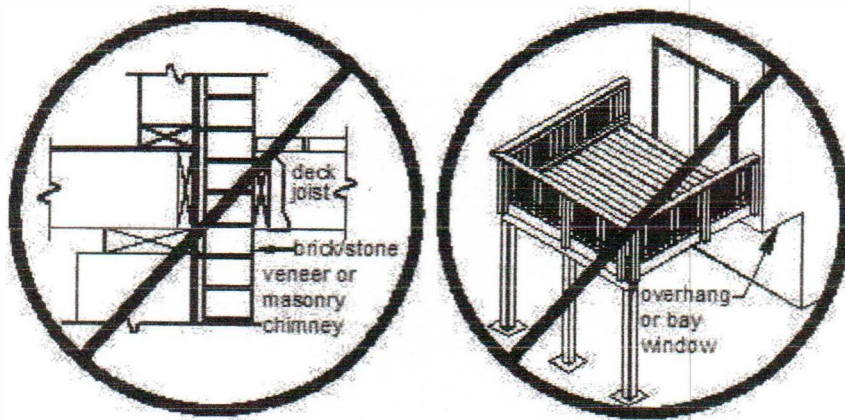

SECTION 9: LEDGER-BOARD FASTENERS

General requirements. Ledger board fasteners must be installed in accordance with this section. Placement and spacing must be in accordance with Figure 15 and Table 6. Only the fastener types listed here are approved for use; lead anchors are prohibited. Adequacy of connections may be verified by local inspectors.

**Figure 15
LEDGER BOARD FASTENER SPACING AND CLEARANCES**

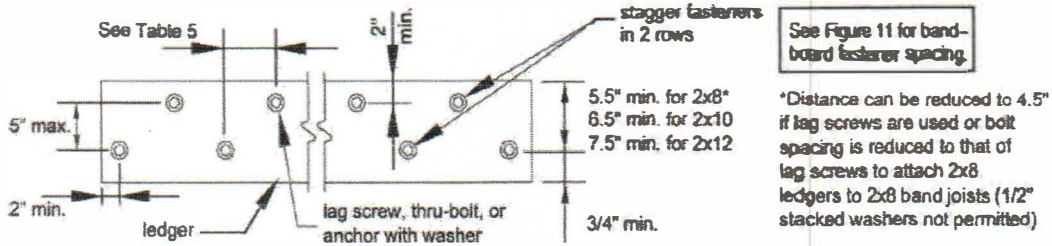

The minimum vertical separation between fasteners is 1-5/8". See Table 6 below for maximum horizontal spacing.

**Table 6
LEDGER BOARD FASTENER SPACING, ON CENTER^{1,2,3}**

Fastener	Band Board	Joist Span: less than or equal to						
		6'	8'	10'	12'	14'	16'	18'
Lag screws	1" EWP	24"	18"	14"	12"	10"	9"	8"
	1 1/8" EWP	28"	21"	16"	14"	12"	10"	9"
	2x Lumber	30"	23"	18"	15"	13"	11"	10"
Through-Bolts	1" EWP	24"	18"	14"	12"	10"	9"	8"
	1 1/8" EWP	28"	21"	16"	14"	12"	10"	9"
	2x Lumber	36"	36"	34"	29"	24"	21"	19"
Through-Bolts with 1/2" stacked washers ^{4,5}	2x Lumber	36"	36"	29"	24"	21"	18"	16"
Adhesive anchors		32"	32"	32"	24"	24"	16"	16"

¹ These values are valid for deck ledgers consisting of Douglas fir/larch, hem/fir, or southern pine; and for band boards consisting of Douglas fir-larch, hem-fir, spruce-pine-fir, southern pine, or engineered wood product (EWP).

² Where solid-sawn pressure-preservative-treated deck ledgers are attached to engineered wood products (minimum 1" thick wood structural panel band joist or structural composite lumber including laminated veneer lumber), the ledger attachment must be designed in accordance with accepted engineering practice. These tabulated values are in accordance with that practice and are based on 300 lbs and 350 lbs for 1" and 1 1/8" EWP rim board, respectively.

³ The thickness of the sheathing over the band board must not exceed 15/32".

⁴ The maximum gap between the face of the ledger board and face of the wall sheathing is 1/2".


⁵ Wood structural panel sheathing, gypsum board sheathing, or foam sheathing is permitted between the ledger board and the band board. Stacked washers are permitted in combination with wood structural panel sheathing, but are not permitted in combination with gypsum board or foam sheathing. The maximum distance between the face of the ledger board and the face of the band board is 1".

Through-bolts. Through-bolts must have a diameter of 1/2 inch. Pilot holes for through-bolts must be 17/32 to 9/16 inches in diameter. Through-bolts must be equipped with washers at the bolt head and nut. Bolts should be tightened 6 to 12 months after construction due to drying and wood shrinkage.

Expansion anchors. Expansion or adhesive anchors must be used for attaching a ledger board to a concrete or solid masonry wall, as shown in Figure 12. The bolt or threaded rod of expansion anchors must have a diameter of 1/2 inch, which in some cases may result in needing a 5/8 inch-diameter anchor. Expansion anchors must be installed in accordance with the manufacturer's instructions and must be equipped with washers.

Adhesive anchors. Approved adhesive anchors with a 1/2 inch-diameter threaded rod must be used for attaching a ledger board to hollow masonry, as shown in Figure 13. Examples of approved adhesive anchors include the Epon Acrylic 7 by ITW Ramset/Red Head, and the HY-20 by Hilti. Adhesive anchors are also permitted with concrete or solid masonry installations. Adhesive anchors must be installed in accordance with the manufacturer's instructions and must be equipped with washers. Adhesive cartridges should remain on the jobsite for inspector verification.

**Figure 16
LAG SCREW**

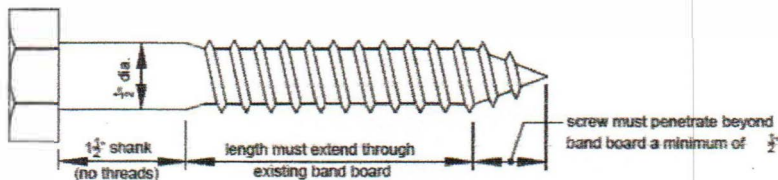

Lag screws. The diameter, length, and shank of lag screws must comply with Figure 16. Lag screws must be equipped with washers and be installed in the following sequence:


1. Drill a 1/2 inch-diameter hole in the ledger board and a 5/16 inch-diameter pilot hole into the solid-connection material of the existing house.
2. Insert the lag screw through the ledger board and into the pilot hole by turning. Do not drive with a hammer. Use soap or a wood-compatible lubricant if needed to facilitate tightening.
3. Tighten each lag screw snugly, but do not over-tighten so as to cause wood damage.

Other screws may be used with proper engineering that is equivalent to the options above.

SECTION 10: FREE-STANDING

A deck that is free-standing does not utilize the exterior wall of the existing house to support vertical loads. Instead, an additional beam is provided at or offset from the existing house wall, as shown in Figure 17. If the edge of a deck footing is closer than 5 feet to an existing exterior house wall, the footing must bear at the same elevation as the existing wall footing as shown in Figure 17. For a house with a basement, a cylindrical footing (caisson) is recommended to minimize required excavation at the basement wall.

**Figure 17
FREE-STANDING DECK**

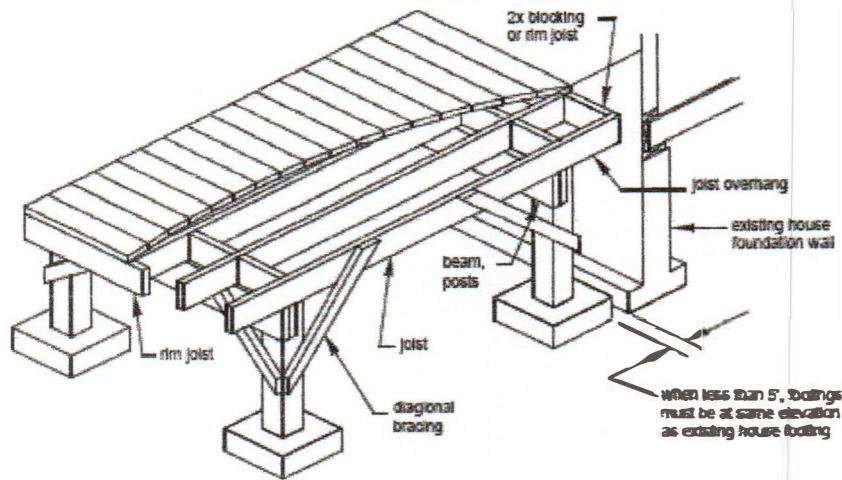

SECTION 11: LATERAL SUPPORT

A deck that is more than 24 inches above grade must resist lateral loads in accordance with the following:

Diagonal Bracing. Provide diagonal bracing both parallel and perpendicular to the beam at each post as shown in Figure 18. Where parallel to the beam, the bracing must be bolted to the post at one end and to the beam at the other. Where perpendicular to the beam, the bracing must be bolted to the post at one end and to a joist or blocking between joists at the other. Where a joist does not align with the bracing location, provide blocking between the adjacent joists.

Exceptions: Bracing is not required perpendicular to the house for a deck that is attached to the house with both a ledger board under sections 8 and 9 and the connection specified in either Figure 19 or 20. For a free-standing deck that is attached to the house as specified in Figure 21, bracing parallel to the house may be omitted at the beam adjacent to the house. All bracing may be omitted for a deck which is attached to the house in accordance with sections 8 and 9 or Figure 21 and which has all of its decking installed at a 45 degree angle to the deck joists.

If the deck surface is greater than 24" above grade at any point, then lateral support is required. If the diagonal bracing method is chosen, individual diagonal braces may be omitted where due to terrain there is not 2' of vertical clearance between the bottom of the wood post and the underside of the braced beam or joist.

Figure 18
DIAGONAL BRACING REQUIREMENTS


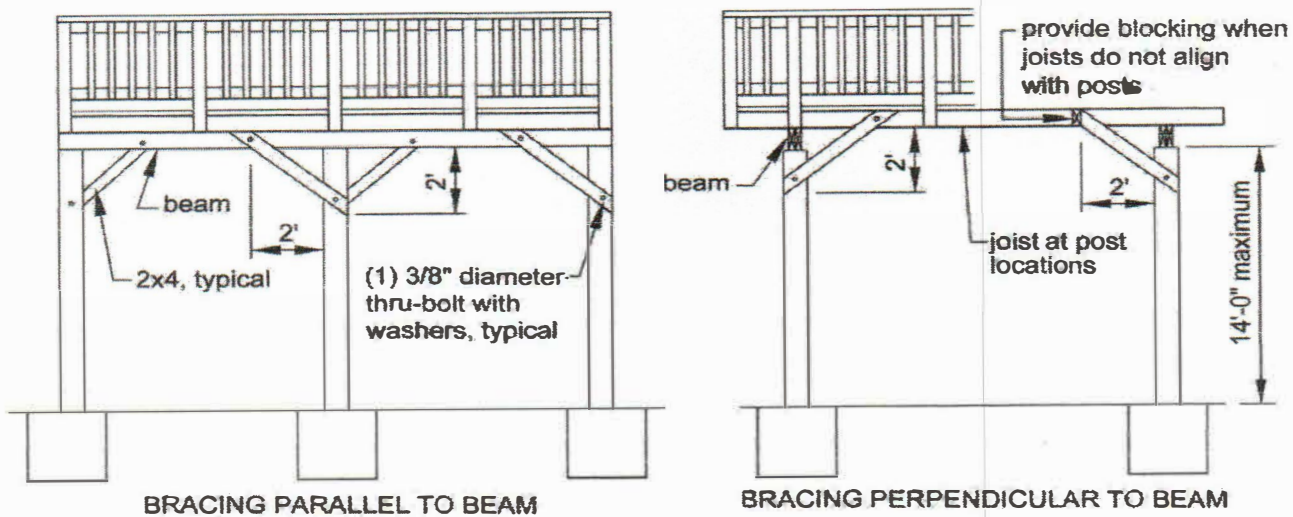



Figure 19
TENSION-TIE CONNECTION, WITH LEDGER BOARD

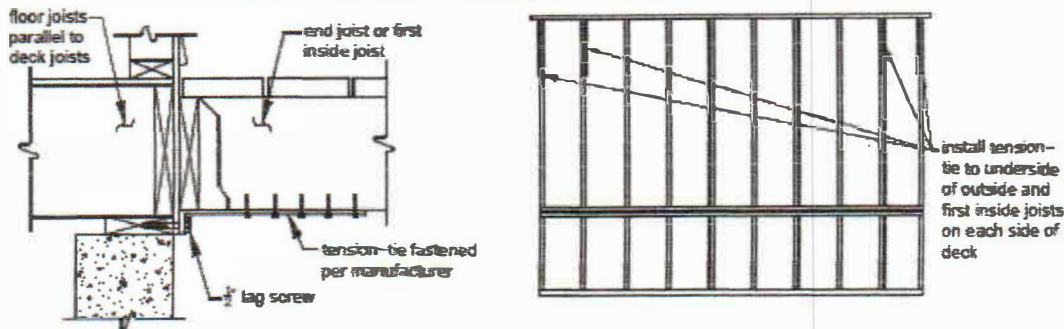

Tension-tie requirements. Tension ties, if used instead of perpendicular bracing as described above, must comply with all of the following, but are not permitted for free-standing decks:

1. The deck joists and floor joists must be parallel.
2. At least 4 ties must be installed, at the end joist and first inside joist at each end of the deck as shown in Figure 19. A set of tension-ties must be installed for each structurally independent section of a multi-level deck.
3. Approved tension-ties include the L TS19-TZ from USP or DTT1Z from Simpson Strong-Tie.
4. The minimum capacity of each tension-tie is 750 pounds.
5. Tension ties which are not available in a G-185 zinc coating require a barrier membrane separating the tension tie and the preservative-treated joist. The barrier membrane must be recommended for this location by its manufacturer.
6. Tension-ties must be attached to the underside of the joists in accordance with the manufacturer's instructions. Tension-ties must be attached to the exterior wall with lag screws as shown in Figure 19. Lag screws must penetrate a minimum of 3 inches into the sill plate or top plate of a wood-framed wall.
7. Where attaching to a concrete wall, lags screws may be replaced with adhesive or expansion anchors and a 1/2 inch threaded rod, with a withdrawal capacity of at least 750 pounds. The anchor must be installed in accordance with the manufacturer's instructions.


Figure 20
HOLD-DOWN TENSION DEVICE, WITH LEDGER BOARD

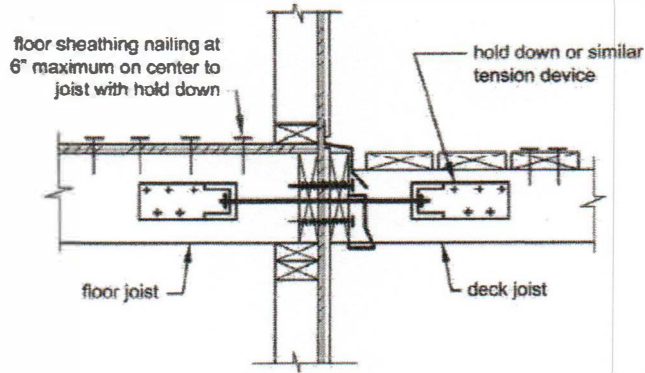

Hold-down tension devices. Hold-down tension devices, if used instead of perpendicular bracing as described above, must be provided in at least 2 locations per deck, and each device must have an allowable-stress-design capacity of at least 1,500 pounds.

Free-standing deck ± attachment to house. Attach the deck's rim joist to the existing house exterior wall as shown in Figure 21 for a free-standing deck, if diagonal bracing parallel to the house is omitted, as described above. The wall must be sheathed with minimum 3/8 inch wood structural panel sheathing. Use lag screws or through-bolts if fastening to an existing band joist or wall stud; and use expansion or adhesive anchors if fastening to concrete or masonry. Do not attach to brick veneers. Verify this condition in the field prior to utilizing this method. Fasteners must be 16 inches on center and staggered in 2 rows. Flashing over the rim joist is required and must be installed in accordance with the flashing provisions in section 8.

Figure 21
ATTACHMENT OF FREE-STANDING DECK TO HOUSE FOR LATERAL SUPPORT

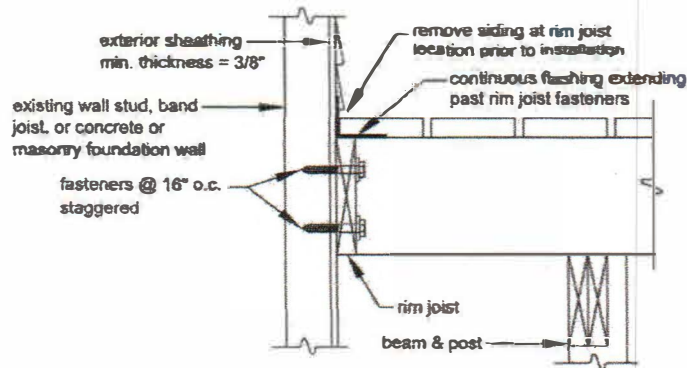

SECTION 12: DECKING

All decking materials must be wood or a wood-plastic composite and must comply with all of the following:

1. Wood decking must be 2x4s, 2x6s, or five-quarter span-rated decking boards. Wood-plastic-composite sizes must be in accordance with the manufacturer's instructions. Plastic decking may be used if it is approved by a professional testing organization for supporting a live load of 40 psf and is installed according to the manufacturer's instructions.
2. Decking must be attached in accordance with Figure 22, and may be placed at an angle of 45 to 90 degrees to the joists unless disallowed in the manufacturer's instructions. If the decking is wet, place it with no gap so that after drying, a 1/8-inch gap is created.

Typically an 1/8" gap will develop after wet treated-lumber dries out. Engineered hidden deck fasteners may also be used but not if diagonal decking is used to satisfy the requirement for lateral bracing of section 11.

3. Decking may overhang a joist by up to 3 inches unless disallowed in the manufacturer's instructions.
4. The center-to-center joist spacing may be up to 24 inches for wood decking, but may not exceed 16 inches for wood-plastic-composite decking unless specified otherwise by the manufacturer.
5. Each wood decking member must bear on a minimum of 4 joists or intermediate blocking between joists.


Providing 4 supports per piece of decking will provide a stiffer deck floor, but per the UDC-adopted NDS for repetitive member joist design values and the ALSC standard for span-rated decking, only three supports are required. For diagonal decking, intermediate blocking will typically be required at the corners of the deck.

6. Placement and attachment of wood-plastic composites must be in accordance with the manufacturer's instructions.
7. Attach the decking to the rim joist in accordance with Figure 23.


Unless engineering data is provided or span-rated 5/4" decking is used, the following table based on the International Residential Code provides acceptable deck spans for wood decking:

Nominal Wood Thickness	Maximum On-Center Joist Spacing	
	Perpendicular to Joist	Diagonal to Joist
1-1/4"	16"	12"
2"	24"	16"

**Figure 22
TYPICAL DECKING**

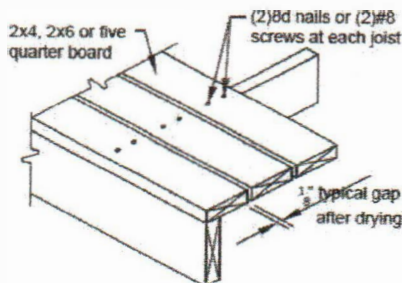

**Figure 23
RIM JOIST CONNECTION**

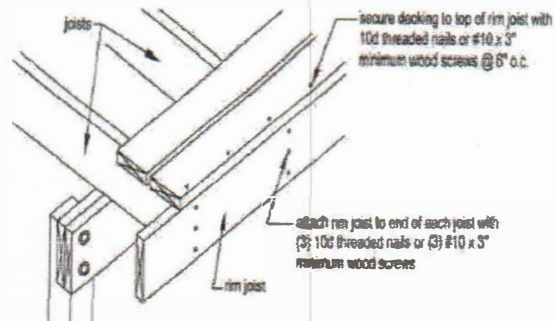


SECTION 13: GUARD AND POSTS

All open sides of a deck area that is more than 24 inches above grade ± at any point within 36 inches beyond the edge of the deck ± must have a guard that complies with Figure 24 and with all of the following:

1. Required horizontal guards shall not have openings from the walking surface to the required guard height which allow passage of a sphere 4 inches in diameter, when applying a force of 4 pounds.

The correct maximum guard opening per SPS 321.04 of the UDC is 4-3/8".

2. Required guards at stairs shall not have openings which allow passage of a sphere 4 3/8 inches in diameter, when applying a force of 4 pounds, other than the triangular opening at the side of an open stair formed by the riser, tread, and bottom rail of a guard, which shall not allow passage of a 6 inch sphere, when applying a force of 4 pounds.
3. Wet lumber must be spaced such that when shrinkage due to drying occurs, a compliant opening is maintained.
4. Rope, cable, or a similar non-rigid material may be used instead of balusters if it is strung with maximum openings of 3 1/2 inches and with vertical supports no more than 4 feet apart.
5. The guard and posts must withstand a 200-pound load applied in any direction.
6. Guard-infill components, such as balusters and panel fillers, must withstand a horizontally applied, perpendicular load of 50 pounds on any one-foot-square area.
7. Wood-plastic composites of equivalent dimensions may be substituted for the guard cap and infill elements shown in Figure 24 if the manufacturer's instructions permit this use.

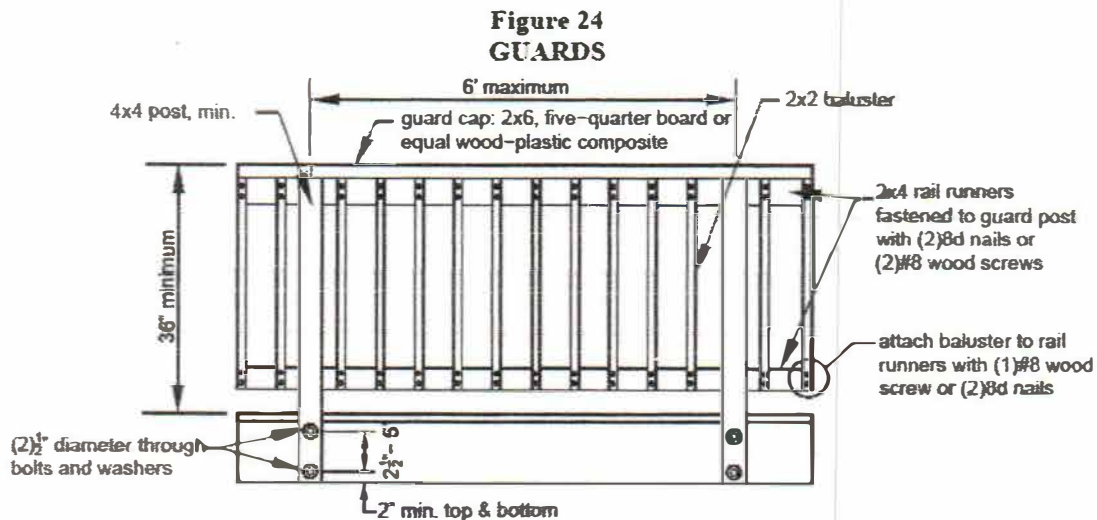

Guard posts. Guard posts must be attached to the deck structure in accordance with all of the following:

Notching guard posts, as shown in Figure 25, is prohibited.

1. Notching guard posts, as shown in Figure 25, is prohibited.
2. Hold-down anchors must have a minimum capacity of 1,800 pounds.
3. Guard posts may be attached to either side of the end joist or rim joist.
4. Bolt holes for a post must be at least 2 inches from the wood edge, at least 2 1/2 inches apart, and no more than 5 inches apart.
5. Hold-down anchors, as shown in Figures 26 and 27, must be used to attach the guard post to the end joist and rim joist, respectively.

**Figure 25
POST NOTCHING PROHIBITED**

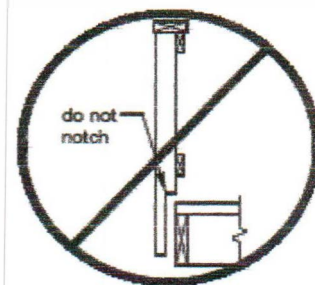


Figure 26
GUARD POST TO END JOIST


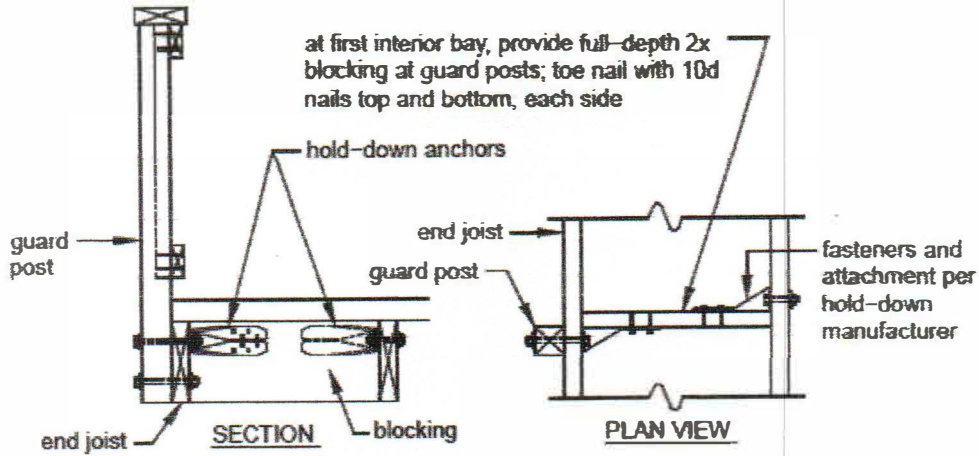


Figure 26
GUARD POST TO RIM JOIST

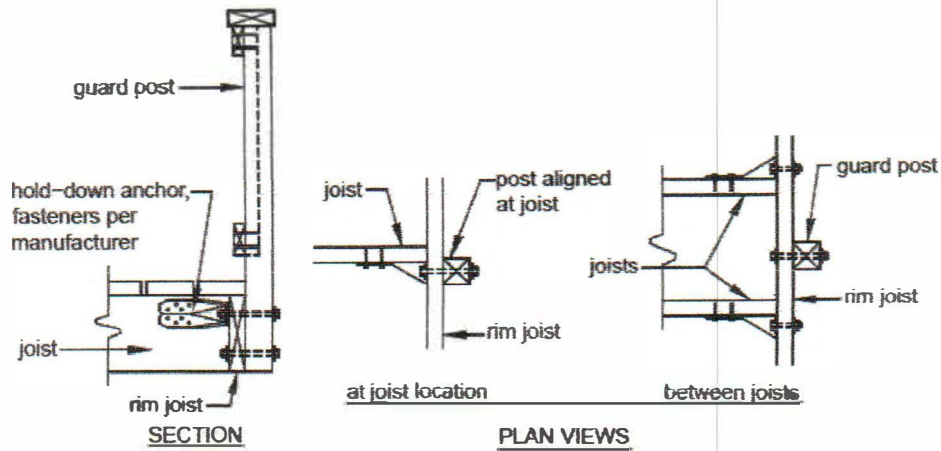


SECTION 14: STAIRS

Stair dimensions. Stair dimensions must comply with all of the following:

1. The minimum width of a stairway is 36 inches.
2. Handrails and associated trim may project a maximum of 4 1/2 inches into the required width at each side of the stairway. The minimum clear width at and below the handrail, including at treads and landings, cannot be less than 31 1/2 inches where a handrail is installed on one side, and 27 inches where handrails are provided on both sides.
3. Stair geometry and openings must be as shown in Figure 27.

2016-App Comm B-22

Figure 27
TREADS AND RISERS

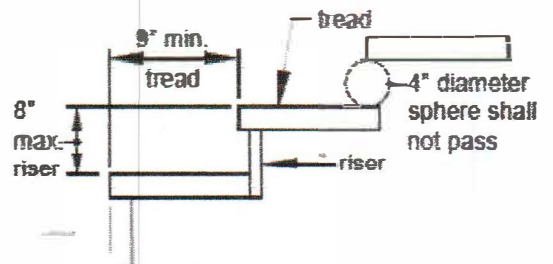

In order to meet the maximum riser opening of Figure 27, infill material shall meet the strength requirements of Section 13, Guard and Posts.

4. Within a stairway flight, the largest tread depth may not exceed the smallest tread depth by more than 3/8 inch, and the largest riser height may not exceed the smallest riser height by more than 3/8 inch.
5. If the total vertical height of a stairway exceeds 12 feet, an intermediate landing is required and must be constructed as a free-standing deck with flush beams and with posts.
6. Any landing width must equal or exceed the total width of the stairway it serves.

Per s. SPS 321.04(4)(d) of the UDC, exterior stair landings shall slope away from the dwelling. They may be of any stable material, including turf.

Stair stringers. Stringers must comply with all of the following:

1. Stringers must be sawn or solid 2"x12"s complying with the above tread and riser dimensions.
2. Cut stringers must be spaced no more than 18 inches on center.

Closer spacing may be required for composite wood plastic decking treads.

3. Stringers must bear on a solid surface, a minimum of 3 1/2 inches thick and 8 inches in diameter, and attach to the deck or a landing in accordance with Figure 28. Prior to placement of solid surface, all loose or organic material shall be removed.
4. Stringer-span length is measured using the horizontally projected distance between the centerlines of bearing at each end.
5. The span length of a cut stringer must not exceed 6 feet-0 inches, and the throat size of cut stringers must not be less than 5 inches, as shown in Figure 29.


The minimum stringer throat dimension is shown in Figures 28 & 30.

Solid-stringer exception: Stringers for a stairway that has a width of 36 inches may have a horizontally projected span of up to 13 feet 3 inches if the stairway is framed solely with 2 solid stringers.

Intermediate-supported stringers: If the total stringer length exceeds the above dimensions, a 4"x4" post may be provided to support the stringer and shorten its span length. The 4"x4" post must be notched and bolted to the stringer in accordance with Figure 2. The post must bear over the middle one-third of a footing that is constructed in accordance with Figure 29 and must be attached as shown in Figure 2. An intermediate landing as described above may also be provided to shorten the stringer span.


Two posts and a header may be used to support the intermediate stringer of a stair.

**Figure 28
STRINGER BEARING**

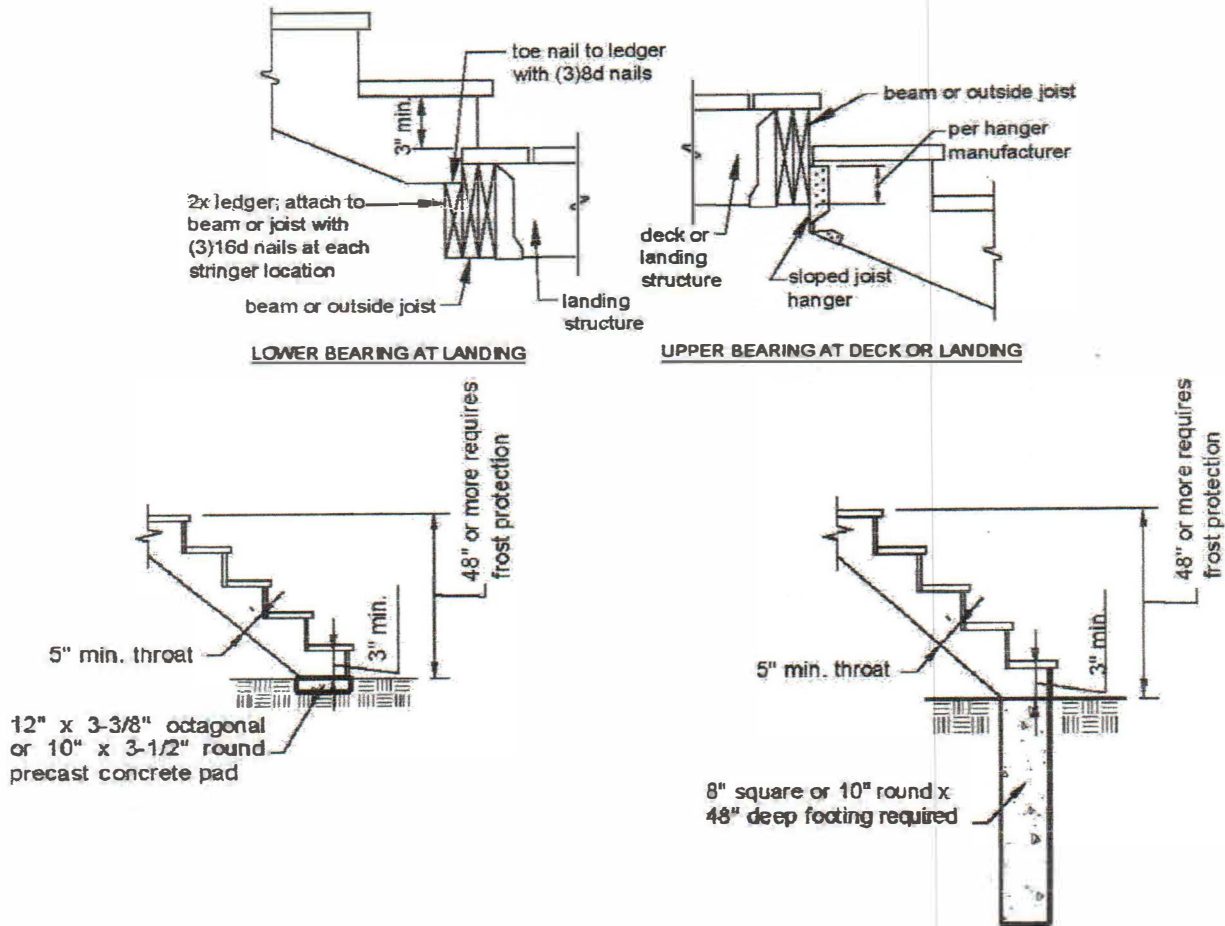


Per Item 3 of Stair Stringers above, the minimum solid surface bearing is $1\text{-}1/2\text{''} \times 8\text{''}$. The solid surface may be concrete, compacted rock, blacktop or similar material.

**Figure 29
STRINGER BEARING**

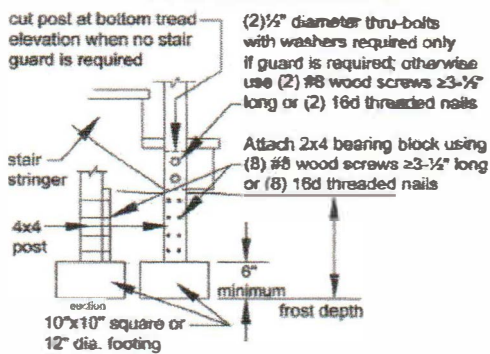

**Figure 30
STRINGER SPAN LENGTH**

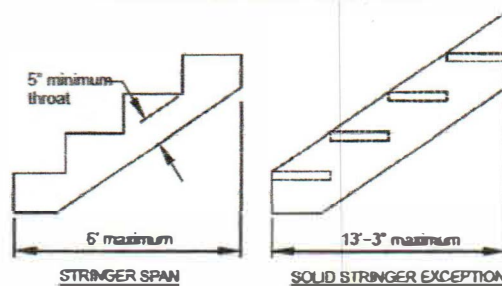

Per Item 4 of the Stair Stringer section above, stringer span may be measured to the centerlines of the bearing at each end. Minimum bearing length is $1\text{-}1/2\text{''}$.

Tread and riser material. Treads and risers must comply with all of the following:

1. Tread material must be equivalent to the decking specified in section 12 and be attached in accordance with Figure 31, except wood-plastic composites must be attached in accordance with the manufacturer's instructions.
2. Stairs constructed using the solid-stringer exception noted above must have treads constructed of 2x wood material only and be attached in accordance with Figure 30.

Stairway tread construction is shown by Figure 31.

3. Risers that are not open (as shown in Figure 27) must be framed with 1x lumber minimum or an manufacturer recommended wood-plastic composite.

Figure 31
STAIRWAY TREADS

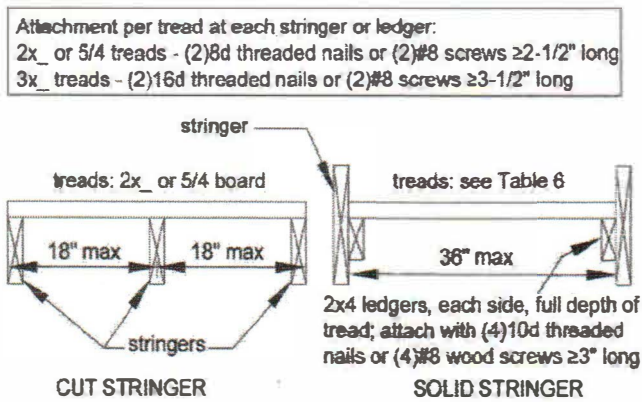


Table 7
MINIMUM TREAD SIZES¹

Species	Cut Stringer	Solid Stringer
Douglas Fir/ Larch, Hem/ Fir, SPF ²	2x4 or 5/4	2x8 or 3x4
Southern Pine	2x4 or 5/4	2x8
Redwood, West- ern Cedars, Pon- derosa Pine ³ , Red Pine ³	2x4 or 5/4	2x10 or 3x4

¹ Assumes 300 lb concentrated load, L/288 deflection limit, No. 2 grade, and wet service conditions.


² Incising assumed for refractory species including Douglas fir-larch, hem-fir, and spruce-pine-fir.

³ Design values based on northern species with no incising assumed.

See Table 7 for minimum tread dimensions.

Stair guards. Guards must be provided on all open sides of stairs consisting of more than 3 risers. Stair guards must comply with section 13 and Figure 32.


Figure 32
STAIR GUARDS

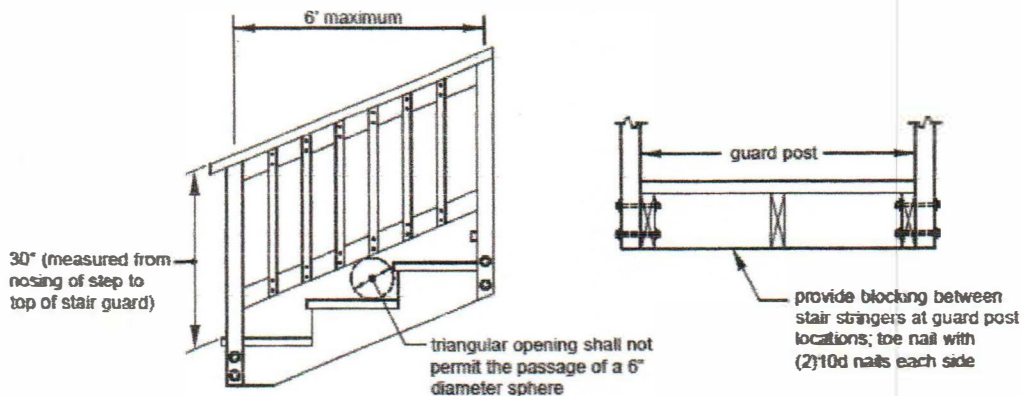

Stair handrails. A flight of stairs with more than 3 risers must have at least one handrail that complies with all of the following:


1. The handrail must be located at least 30 inches, but no more than 38 inches above the nosing of the treads ± except that a volute, turnout, starting easing, or transition fitting may depart from these dimensions. Measurement must be taken from the nosing to the top of the rail.
2. The handrail must be attached to a stair guard or exterior wall acting as a barrier as shown in Figure 33.
3. The handrail and connecting hardware must be decay- and corrosion-resistant.
4. The handrail must have a smooth surface with no sharp corners and must be graspable, as shown in Figure 34. Recessed sections may be shaped from a 2"x6" or five-quarter board, as shown there.
5. Handrails must run continuously from a point directly over the lowest riser to a point directly over the highest riser.

**Figure 33
STAIR HANDRAILS**

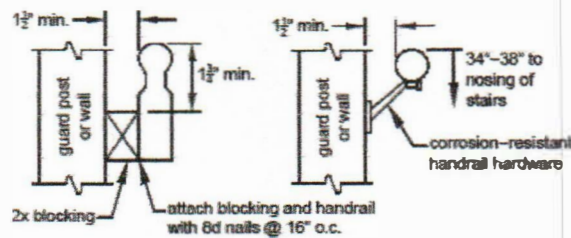

6. Handrails may be interrupted by guard posts.

**Figure 34
HANDRAIL GRASPABILITY**

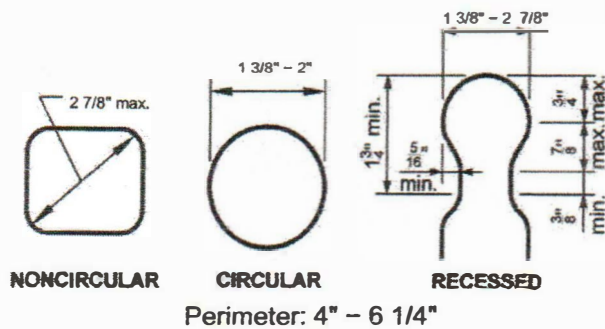


The UDC Appendix A drawing for handrails with recessed gripping surfaces allows a minimum $\frac{1}{4}$ \"

Spiral stairs. Stair dimensions above are for standard stairs secured in accordance with methods shown in this appendix. Spiral stairs are allowed at decks when designed in accordance with the provisions of Chapter SPS 321.04. Connection of spiral stairs to decks and the supporting load path shall be designed in accordance with accepted engineering practices and with applicable provisions of the Uniform Dwelling Code.

SECTION 15: FRAMING PLAN

A typical framing plan shows a bird's-eye or plan view of the joist and beam layout; the location of the ledger board, diagonal bracing or hold-down devices, posts, and footings; and the type, size, and spacing of the ledger board fasteners. You can use the sample typical deck framing plan shown on the next page in combination with the requirements in this document to complete your deck.

**Figure 35
TYPICAL DECK FRAMING PLAN**

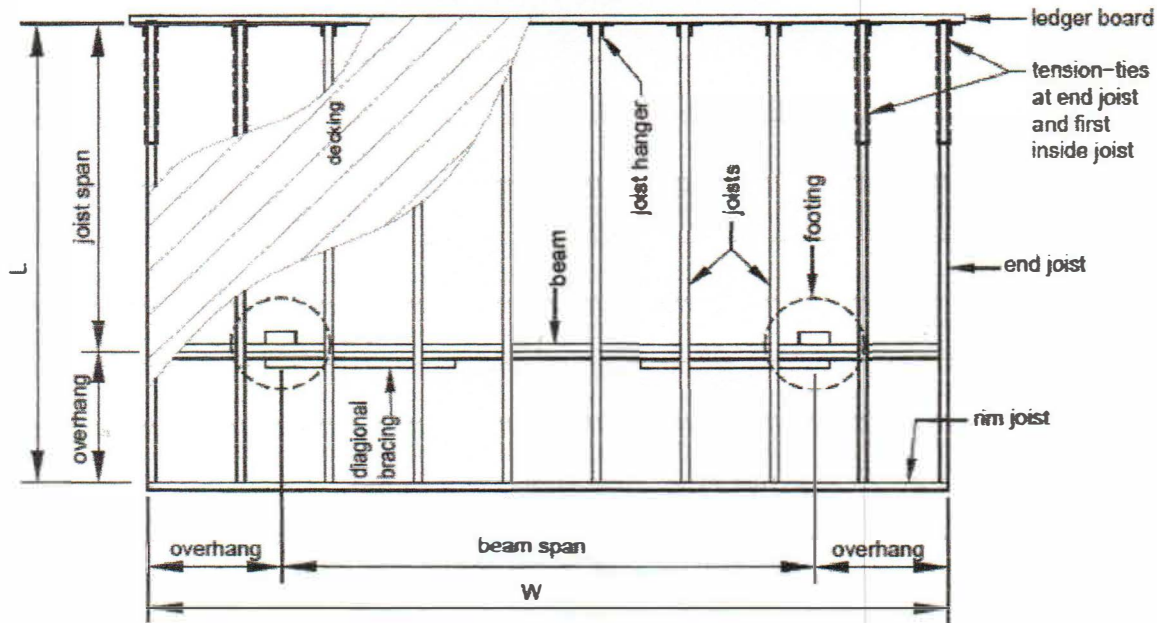

Decking: 2x4 2x6 five-quarter board wood-plastic composite (per ASTM D 7032)
 Other decking, evaluation report number: _____

Joists: size: 2x6 2x8 2x10 2x12 spacing: 12 in. 16 in. 24 in.
joist span dimension: _____ ft. - _____ in.
overhang: Yes No overhang dimension: _____ ft. - _____ in.
rim joist: 2x6 2x8 2x10 2x12

Beam(s): number of plies: 2 3 size: 2x6 2x8 2x10 2x12
overhang: Yes No overhang dimension: _____ ft. - _____ in.

Posts: size: 4x4 4x6 6x6 height: _____ ft. - _____ in.

Footings: size: _____ in. square round thickness: _____ in.

Ledger: ledger board size: 2x8 2x10 2x12 Not applicable (free-standing deck)
fastener: Through bolt Lag screw Wood screw
 Expansion anchor Adhesive anchor

Lateral support: Tension-tie Diagonal bracing, size: 2x
(not permitted for free-standing deck)

Deck size: L= _____ ft. - _____ in. W= _____ ft. - _____ in.